

TABLE 2

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Effluent Water Quality Results

Date Sampled ^{2/}	pH ^{1/}	TDS ^{4/} (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis- 1,2-DCE (ug/l)	trans- 1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethyl- benzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	6.5 to 8.5	---	5	5	5	5	5	5	5	5	5	5	5	---	10	7	---	---
1-Feb-19	6.9	126	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.641	ND<0.278
1-Mar-19	6.9	142	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	6.31	ND<0.278
2-Apr-19	6.9	153	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	1.27	ND<0.278
6-May-19	6.9	175	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.374	ND<0.278
4-Jun-19	6.0	139	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.620	ND<0.278
2-Jul-19	6.0	145	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	1.82 C,Q,B	ND<0.5	0.766	ND<0.278
1-Aug-19	6.8	168	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	1.30	1.24
5-Sep-19	6.8	172	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.291	ND<0.278
3-Oct-19	6.5	165	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.612	ND<0.278
4-Nov-19	6.0	102	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.536	ND<0.278
5-Dec-19	6.8	129	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
7-Jan-20	6.8	175	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
4-Feb-20	7.0	122	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
2-Mar-20	7.0	137	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected NA: Not Analyzed

C = CCV-E: The value reported is estimated. The value is estimated due to its behavior during continuing calibration verification.


Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

Notes:


- Based on the SPDES criteria from an NYSDEC letter dated on May 6, 2016, the allowable pH range for the Rowe Site is between 6.5 and 8.5. The effluent pH was 7.0 on March 19, 2020. Historic pH measurements from recovery wells indicate that natural background pH concentrations are less than 6.5.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- Starting in October 2016, FSP&T system samples are collected monthly instead of once every two weeks. The pH of the effluent water is measured two times per month in accordance with the SPDES requirements.

GRAPH 1
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

Effluent Flow Data
(March 1, 2020 to March 31, 2020)

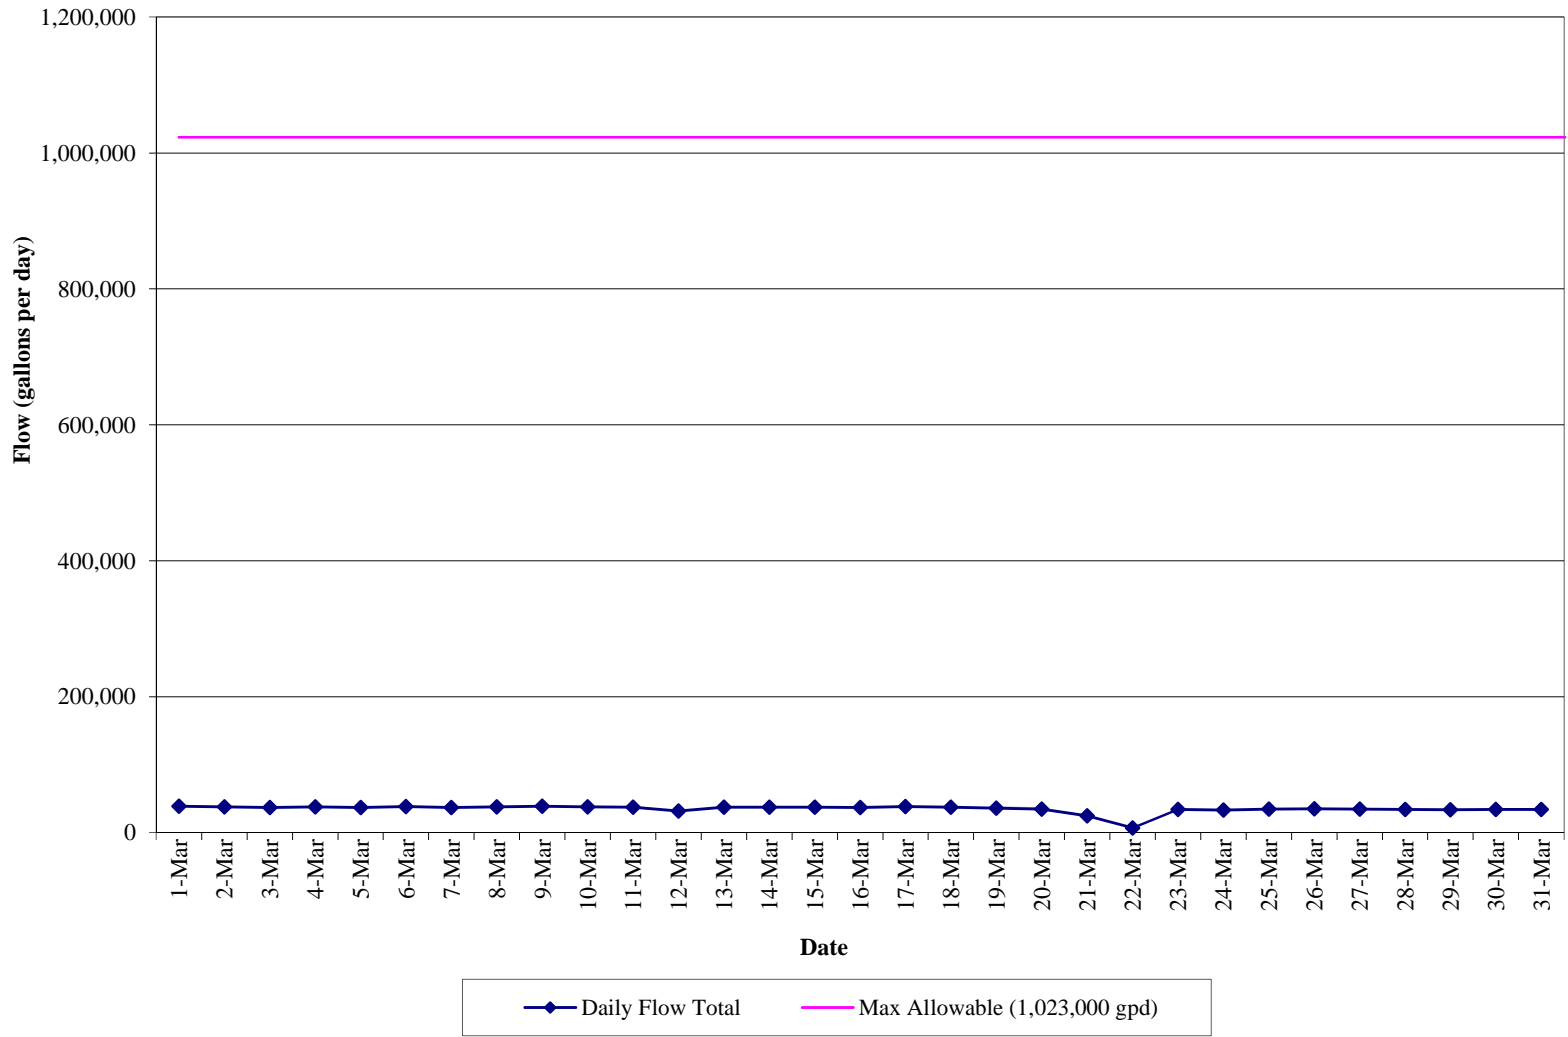

APPENDIX I
MARCH 2020 LABORATORY ANALYTICAL REPORT
FOR FSP&T SYSTEM



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 03/09/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20C0057

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 03/09/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20C0057

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on March 02, 2020 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20C0057-01	WQ030220:0825 NP2-6	Water	03/02/2020	03/02/2020
20C0057-02	WQ030220:0830 NP2-10	Water	03/02/2020	03/02/2020

General Notes for York Project (SDG) No.: 20C0057

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 03/09/2020





Sample Information

Client Sample ID: WQ030220:0825 NP2-6

York Sample ID: 20C0057-01

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
20C0057	31401451.000 Task 01.00 Rowe Industries	Water	March 2, 2020 8:25 am	03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	03/06/2020 12:30	03/07/2020 06:28	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS



Sample Information

Client Sample ID: WQ030220:0825 NP2-6

York Sample ID: 20C0057-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0057

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:25 am

03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS



Sample Information

Client Sample ID: WQ030220:0825 NP2-6

York Sample ID: 20C0057-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0057

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:25 am

03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
127-18-4	Tetrachloroethylene	1.66	CCV-E	ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
79-01-6	Trichloroethylene	0.220		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:28	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	03/06/2020 12:30	03/07/2020 06:28	SS
	Surrogate Recoveries	Result			Acceptance Range						
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	97.7 %			69-130						
2037-26-5	Surrogate: SURRE: Toluene-d8	98.9 %			81-117						
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	106 %			79-122						



Sample Information

Client Sample ID: WQ030220:0830 NP2-10

York Sample ID: 20C0057-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0057

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:30 am

03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	03/06/2020 12:30	03/07/2020 06:57	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS



Sample Information

Client Sample ID: WQ030220:0830 NP2-10

York Sample ID: 20C0057-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0057

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:30 am

03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS



Sample Information

Client Sample ID: WQ030220:0830 NP2-10

York Sample ID: 20C0057-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0057

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:30 am

03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 06:57	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	03/06/2020 12:30	03/07/2020 06:57	SS

	Surrogate Recoveries	Result	Acceptance Range
17060-07-0	Surrogate: SURR: 1,2-Dichloroethane-d4	96.6 %	69-130
2037-26-5	Surrogate: SURR: Toluene-d8	99.9 %	81-117
460-00-4	Surrogate: SURR: p-Bromofluorobenzene	108 %	79-122

Total Dissolved Solids

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: WQ030220:0830 NP2-10

York Sample ID: 20C0057-02

<u>York Project (SDG) No.</u> 20C0057	<u>Client Project ID</u> 31401451.000 Task 01.00 Rowe Industries	<u>Matrix</u> Water	<u>Collection Date/Time</u> March 2, 2020 8:30 am	<u>Date Received</u> 03/02/2020
--	---	------------------------	--	------------------------------------

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst	
	Total Dissolved Solids	137		mg/L	10.0	1	SM 2540C	03/04/2020 17:05	03/06/2020 21:35	AA	
							Certifications:	NELAC-NY10854,CTDOH,NJDEP,PADEP			



Analytical Batch Summary

Batch ID: BC00231 **Preparation Method:** % Solids Prep **Prepared By:** AA

YORK Sample ID	Client Sample ID	Preparation Date
20C0057-02	WQ030220:0830 NP2-10	03/04/20
BC00231-BLK1	Blank	03/04/20

Batch ID: BC00345 **Preparation Method:** EPA 5030B **Prepared By:** MAT

YORK Sample ID	Client Sample ID	Preparation Date
20C0057-01	WQ030220:0825 NP2-6	03/06/20
20C0057-02	WQ030220:0830 NP2-10	03/06/20
BC00345-BLK1	Blank	03/06/20
BC00345-BS1	LCS	03/06/20
BC00345-BS2	LCS	03/06/20
BC00345-BSD1	LCS Dup	03/06/20
BC00345-BSD2	LCS Dup	03/06/20



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

Blank (BC00345-BLK1)

Prepared: 03/06/2020 Analyzed: 03/07/2020

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

Blank (BC00345-BLK1)

Prepared: 03/06/2020 Analyzed: 03/07/2020

n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<hr/>											
Surrogate: SURR: 1,2-Dichloroethane-d4	9.92		"	10.0		99.2	69-130				
Surrogate: SURR: Toluene-d8	9.93		"	10.0		99.3	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.4		"	10.0		104	79-122				

LCS (BC00345-BS1)

Prepared & Analyzed: 03/06/2020

1,1,1,2-Tetrachloroethane	11.4		ug/L	10.0		114	82-126				
1,1,1-Trichloroethane	10.6		"	10.0		106	78-136				
1,1,2,2-Tetrachloroethane	9.32		"	10.0		93.2	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.1		"	10.0		111	54-165				
1,1,2-Trichloroethane	9.70		"	10.0		97.0	82-123				
1,1-Dichloroethane	10.0		"	10.0		100	82-129				
1,1-Dichloroethylene	11.9		"	10.0		119	68-138				
1,1-Dichloropropylene	10.3		"	10.0		103	83-133				
1,2,3-Trichlorobenzene	9.49		"	10.0		94.9	76-136				
1,2,3-Trichloropropane	9.44		"	10.0		94.4	77-128				
1,2,4-Trichlorobenzene	9.50		"	10.0		95.0	76-137				
1,2,4-Trimethylbenzene	9.91		"	10.0		99.1	82-132				
1,2-Dibromo-3-chloropropane	8.68		"	10.0		86.8	45-147				
1,2-Dibromoethane	10.1		"	10.0		101	83-124				
1,2-Dichlorobenzene	9.48		"	10.0		94.8	79-123				
1,2-Dichloroethane	10.2		"	10.0		102	73-132				
1,2-Dichloropropane	9.96		"	10.0		99.6	78-126				
1,3,5-Trimethylbenzene	10.0		"	10.0		100	80-131				
1,3-Dichlorobenzene	9.34		"	10.0		93.4	86-122				
1,3-Dichloropropane	10.1		"	10.0		101	81-125				
1,4-Dichlorobenzene	10.9		"	10.0		109	85-124				
2,2-Dichloropropane	8.00		"	10.0		80.0	56-150				
2-Chlorotoluene	9.73		"	10.0		97.3	79-130				
2-Hexanone	9.69		"	10.0		96.9	51-146				
4-Chlorotoluene	9.70		"	10.0		97.0	79-128				
Acetone	7.99		"	10.0		79.9	14-150				
Benzene	10.6		"	10.0		106	85-126				
Bromobenzene	9.70		"	10.0		97.0	78-129				
Bromochloromethane	10.6		"	10.0		106	77-128				
Bromodichloromethane	10.3		"	10.0		103	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BC00345 - EPA 5030B											
LCS (BC00345-BS1)											
Prepared & Analyzed: 03/06/2020											
Bromoform	9.46		ug/L	10.0		94.6	78-133				
Bromomethane	13.2		"	10.0		132	43-168				
Carbon tetrachloride	10.3		"	10.0		103	77-141				
Chlorobenzene	9.83		"	10.0		98.3	88-120				
Chloroethane	15.1		"	10.0		151	65-136	High Bias			
Chloroform	10.5		"	10.0		105	82-128				
Chloromethane	11.4		"	10.0		114	43-155				
cis-1,2-Dichloroethylene	10.0		"	10.0		100	83-129				
cis-1,3-Dichloropropylene	9.73		"	10.0		97.3	80-131				
Dibromochloromethane	9.87		"	10.0		98.7	80-130				
Dibromomethane	9.96		"	10.0		99.6	72-134				
Dichlorodifluoromethane	12.8		"	10.0		128	44-144				
Ethyl Benzene	10.2		"	10.0		102	80-131				
Hexachlorobutadiene	9.32		"	10.0		93.2	67-146				
Isopropylbenzene	9.78		"	10.0		97.8	76-140				
Methyl tert-butyl ether (MTBE)	10.3		"	10.0		103	76-135				
Methylene chloride	11.8		"	10.0		118	55-137				
Naphthalene	9.53		"	10.0		95.3	70-147				
n-Butylbenzene	10.2		"	10.0		102	79-132				
n-Propylbenzene	9.90		"	10.0		99.0	78-133				
o-Xylene	9.81		"	10.0		98.1	78-130				
p- & m- Xylenes	21.1		"	20.0		106	77-133				
p-Isopropyltoluene	9.86		"	10.0		98.6	81-136				
sec-Butylbenzene	10.5		"	10.0		105	79-137				
Styrene	10.7		"	10.0		107	67-132				
tert-Butylbenzene	9.53		"	10.0		95.3	77-138				
Tetrachloroethylene	8.47		"	10.0		84.7	82-131				
Toluene	10.3		"	10.0		103	80-127				
trans-1,2-Dichloroethylene	11.4		"	10.0		114	80-132				
trans-1,3-Dichloropropylene	9.73		"	10.0		97.3	78-131				
Trichloroethylene	10.4		"	10.0		104	82-128				
Trichlorofluoromethane	12.6		"	10.0		126	67-139				
Vinyl Chloride	13.9		"	10.0		139	58-145				
Surrogate: SURRE: 1,2-Dichloroethane-d4	9.30		"	10.0		93.0	69-130				
Surrogate: SURRE: Toluene-d8	10.0		"	10.0		100	81-117				
Surrogate: SURRE: p-Bromofluorobenzene	10.0		"	10.0		100	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting		Spike	Source*		%REC	Limits	Flag	RPD	
		Limit	Units		Level	Result				%REC	RPD

Batch BC00345 - EPA 5030B

LCS (BC00345-BS2)

Prepared: 03/06/2020 Analyzed: 03/07/2020

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	Limits	Flag	RPD	Limit	Flag
1,1,1,2-Tetrachloroethane	11.3		ug/L	10.0		113	82-126				
1,1,1-Trichloroethane	10.4		"	10.0		104	78-136				
1,1,2,2-Tetrachloroethane	9.24		"	10.0		92.4	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.2		"	10.0		112	54-165				
1,1,2-Trichloroethane	9.94		"	10.0		99.4	82-123				
1,1-Dichloroethane	9.98		"	10.0		99.8	82-129				
1,1-Dichloroethylene	11.8		"	10.0		118	68-138				
1,1-Dichloropropylene	10.3		"	10.0		103	83-133				
1,2,3-Trichlorobenzene	9.01		"	10.0		90.1	76-136				
1,2,3-Trichloropropane	9.38		"	10.0		93.8	77-128				
1,2,4-Trichlorobenzene	8.85		"	10.0		88.5	76-137				
1,2,4-Trimethylbenzene	9.45		"	10.0		94.5	82-132				
1,2-Dibromo-3-chloropropane	8.66		"	10.0		86.6	45-147				
1,2-Dibromoethane	9.81		"	10.0		98.1	83-124				
1,2-Dichlorobenzene	9.15		"	10.0		91.5	79-123				
1,2-Dichloroethane	10.2		"	10.0		102	73-132				
1,2-Dichloropropane	9.91		"	10.0		99.1	78-126				
1,3,5-Trimethylbenzene	9.60		"	10.0		96.0	80-131				
1,3-Dichlorobenzene	8.93		"	10.0		89.3	86-122				
1,3-Dichloropropane	10.2		"	10.0		102	81-125				
1,4-Dichlorobenzene	10.6		"	10.0		106	85-124				
2,2-Dichloropropane	7.71		"	10.0		77.1	56-150				
2-Chlorotoluene	9.36		"	10.0		93.6	79-130				
2-Hexanone	9.91		"	10.0		99.1	51-146				
4-Chlorotoluene	9.43		"	10.0		94.3	79-128				
Acetone	8.37		"	10.0		83.7	14-150				
Benzene	10.8		"	10.0		108	85-126				
Bromobenzene	9.51		"	10.0		95.1	78-129				
Bromochloromethane	10.5		"	10.0		105	77-128				
Bromodichloromethane	10.3		"	10.0		103	79-128				
Bromoform	9.42		"	10.0		94.2	78-133				
Bromomethane	12.3		"	10.0		123	43-168				
Carbon tetrachloride	10.2		"	10.0		102	77-141				
Chlorobenzene	9.78		"	10.0		97.8	88-120				
Chloroethane	11.7		"	10.0		117	65-136				
Chloroform	10.6		"	10.0		106	82-128				
Chloromethane	11.6		"	10.0		116	43-155				
cis-1,2-Dichloroethylene	10.2		"	10.0		102	83-129				
cis-1,3-Dichloropropylene	9.60		"	10.0		96.0	80-131				
Dibromochloromethane	10.0		"	10.0		100	80-130				
Dibromomethane	9.51		"	10.0		95.1	72-134				
Dichlorodifluoromethane	12.0		"	10.0		120	44-144				
Ethyl Benzene	10.1		"	10.0		101	80-131				
Hexachlorobutadiene	9.23		"	10.0		92.3	67-146				
Isopropylbenzene	9.46		"	10.0		94.6	76-140				
Methyl tert-butyl ether (MTBE)	10.3		"	10.0		103	76-135				
Methylene chloride	12.0		"	10.0		120	55-137				
Naphthalene	9.19		"	10.0		91.9	70-147				
n-Butylbenzene	9.49		"	10.0		94.9	79-132				
n-Propylbenzene	9.57		"	10.0		95.7	78-133				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BC00345 - EPA 5030B											
LCS (BC00345-BS2)											
						Prepared: 03/06/2020 Analyzed: 03/07/2020					
o-Xylene	9.76		ug/L	10.0		97.6	78-130				
p- & m- Xylenes	20.6		"	20.0		103	77-133				
p-Isopropyltoluene	9.43		"	10.0		94.3	81-136				
sec-Butylbenzene	10.1		"	10.0		101	79-137				
Styrene	10.7		"	10.0		107	67-132				
tert-Butylbenzene	9.19		"	10.0		91.9	77-138				
Tetrachloroethylene	8.16		"	10.0		81.6	82-131	Low Bias			
Toluene	10.3		"	10.0		103	80-127				
trans-1,2-Dichloroethylene	11.6		"	10.0		116	80-132				
trans-1,3-Dichloropropylene	9.73		"	10.0		97.3	78-131				
Trichloroethylene	10.1		"	10.0		101	82-128				
Trichlorofluoromethane	10.2		"	10.0		102	67-139				
Vinyl Chloride	10.3		"	10.0		103	58-145				
Surrogate: SURR: 1,2-Dichloroethane-d4	9.31		"	10.0		93.1	69-130				
Surrogate: SURR: Toluene-d8	9.92		"	10.0		99.2	81-117				
Surrogate: SURR: p-Bromofluorobenzene	9.74		"	10.0		97.4	79-122				
LCS Dup (BC00345-BSD1)											
						Prepared: 03/06/2020 Analyzed: 03/07/2020					
1,1,1,2-Tetrachloroethane	11.2		ug/L	10.0		112	82-126		1.94	30	
1,1,1-Trichloroethane	10.2		"	10.0		102	78-136		3.83	30	
1,1,2,2-Tetrachloroethane	8.93		"	10.0		89.3	76-129		4.27	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.8		"	10.0		108	54-165		2.55	30	
1,1,2-Trichloroethane	9.76		"	10.0		97.6	82-123		0.617	30	
1,1-Dichloroethane	9.87		"	10.0		98.7	82-129		1.61	30	
1,1-Dichloroethylene	11.5		"	10.0		115	68-138		3.59	30	
1,1-Dichloropropylene	10.1		"	10.0		101	83-133		2.35	30	
1,2,3-Trichlorobenzene	8.84		"	10.0		88.4	76-136		7.09	30	
1,2,3-Trichloropropane	9.15		"	10.0		91.5	77-128		3.12	30	
1,2,4-Trichlorobenzene	8.75		"	10.0		87.5	76-137		8.22	30	
1,2,4-Trimethylbenzene	9.22		"	10.0		92.2	82-132		7.21	30	
1,2-Dibromo-3-chloropropane	8.13		"	10.0		81.3	45-147		6.54	30	
1,2-Dibromoethane	9.81		"	10.0		98.1	83-124		2.91	30	
1,2-Dichlorobenzene	8.92		"	10.0		89.2	79-123		6.09	30	
1,2-Dichloroethane	10.2		"	10.0		102	73-132		0.196	30	
1,2-Dichloropropane	9.77		"	10.0		97.7	78-126		1.93	30	
1,3,5-Trimethylbenzene	9.43		"	10.0		94.3	80-131		5.87	30	
1,3-Dichlorobenzene	8.82		"	10.0		88.2	86-122		5.73	30	
1,3-Dichloropropane	9.86		"	10.0		98.6	81-125		2.01	30	
1,4-Dichlorobenzene	10.4		"	10.0		104	85-124		4.52	30	
2,2-Dichloropropane	7.71		"	10.0		77.1	56-150		3.69	30	
2-Chlorotoluene	9.06		"	10.0		90.6	79-130		7.13	30	
2-Hexanone	9.65		"	10.0		96.5	51-146		0.414	30	
4-Chlorotoluene	9.09		"	10.0		90.9	79-128		6.49	30	
Acetone	8.31		"	10.0		83.1	14-150		3.93	30	
Benzene	10.6		"	10.0		106	85-126		0.283	30	
Bromobenzene	9.17		"	10.0		91.7	78-129		5.62	30	
Bromochloromethane	10.5		"	10.0		105	77-128		0.853	30	
Bromodichloromethane	10.0		"	10.0		100	79-128		2.76	30	
Bromoform	9.55		"	10.0		95.5	78-133		0.947	30	
Bromomethane	11.9		"	10.0		119	43-168		10.6	30	



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	
		Limit							Units	Level
Batch BC00345 - EPA 5030B										
LCS Dup (BC00345-BSD1)										
							Prepared: 03/06/2020 Analyzed: 03/07/2020			
Carbon tetrachloride	9.93		ug/L	10.0	99.3	77-141			3.56	30
Chlorobenzene	9.42		"	10.0	94.2	88-120			4.26	30
Chloroethane	11.5		"	10.0	115	65-136			27.1	30
Chloroform	10.3		"	10.0	103	82-128			1.15	30
Chloromethane	11.3		"	10.0	113	43-155			0.968	30
cis-1,2-Dichloroethylene	9.97		"	10.0	99.7	83-129			0.300	30
cis-1,3-Dichloropropylene	9.42		"	10.0	94.2	80-131			3.24	30
Dibromochloromethane	9.75		"	10.0	97.5	80-130			1.22	30
Dibromomethane	9.29		"	10.0	92.9	72-134			6.96	30
Dichlorodifluoromethane	12.0		"	10.0	120	44-144			7.10	30
Ethyl Benzene	9.61		"	10.0	96.1	80-131			6.05	30
Hexachlorobutadiene	8.82		"	10.0	88.2	67-146			5.51	30
Isopropylbenzene	9.23		"	10.0	92.3	76-140			5.79	30
Methyl tert-butyl ether (MTBE)	10.4		"	10.0	104	76-135			0.965	30
Methylene chloride	11.6		"	10.0	116	55-137			2.14	30
Naphthalene	9.16		"	10.0	91.6	70-147			3.96	30
n-Butylbenzene	9.22		"	10.0	92.2	79-132			10.1	30
n-Propylbenzene	9.17		"	10.0	91.7	78-133			7.66	30
o-Xylene	9.37		"	10.0	93.7	78-130			4.59	30
p- & m- Xylenes	19.9		"	20.0	99.4	77-133			6.05	30
p-Isopropyltoluene	9.17		"	10.0	91.7	81-136			7.25	30
sec-Butylbenzene	9.86		"	10.0	98.6	79-137			6.67	30
Styrene	10.4		"	10.0	104	67-132			2.65	30
tert-Butylbenzene	8.90		"	10.0	89.0	77-138			6.84	30
Tetrachloroethylene	8.04		"	10.0	80.4	82-131	Low Bias		5.21	30
Toluene	9.87		"	10.0	98.7	80-127			4.55	30
trans-1,2-Dichloroethylene	11.1		"	10.0	111	80-132			2.50	30
trans-1,3-Dichloropropylene	9.62		"	10.0	96.2	78-131			1.14	30
Trichloroethylene	9.89		"	10.0	98.9	82-128			5.51	30
Trichlorofluoromethane	10.1		"	10.0	101	67-139			21.8	30
Vinyl Chloride	10.3		"	10.0	103	58-145			30.3	30 Non-dir.
Surrogate: SURR: 1,2-Dichloroethane-d4	9.73		"	10.0	97.3	69-130				
Surrogate: SURR: Toluene-d8	10.0		"	10.0	100	81-117				
Surrogate: SURR: p-Bromofluorobenzene	9.94		"	10.0	99.4	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting		Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	
		Limit	Units						RPD	Limit
Batch BC00345 - EPA 5030B										
LCS Dup (BC00345-BSD2)										
Prepared: 03/06/2020 Analyzed: 03/07/2020										
1,1,1,2-Tetrachloroethane	11.2		ug/L	10.0		112	82-126		0.710	30
1,1,1-Trichloroethane	10.3		"	10.0		103	78-136		0.290	30
1,1,2,2-Tetrachloroethane	9.50		"	10.0		95.0	76-129		2.77	30
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.9		"	10.0		109	54-165		1.99	30
1,1,2-Trichloroethane	10.0		"	10.0		100	82-123		0.702	30
1,1-Dichloroethane	10.0		"	10.0		100	82-129		0.200	30
1,1-Dichloroethylene	11.6		"	10.0		116	68-138		1.54	30
1,1-Dichloropropylene	10.3		"	10.0		103	83-133		0.388	30
1,2,3-Trichlorobenzene	9.34		"	10.0		93.4	76-136		3.60	30
1,2,3-Trichloropropane	9.36		"	10.0		93.6	77-128		0.213	30
1,2,4-Trichlorobenzene	9.32		"	10.0		93.2	76-137		5.17	30
1,2,4-Trimethylbenzene	9.48		"	10.0		94.8	82-132		0.317	30
1,2-Dibromo-3-chloropropane	8.83		"	10.0		88.3	45-147		1.94	30
1,2-Dibromoethane	10.2		"	10.0		102	83-124		4.19	30
1,2-Dichlorobenzene	9.27		"	10.0		92.7	79-123		1.30	30
1,2-Dichloroethane	10.2		"	10.0		102	73-132		0.196	30
1,2-Dichloropropane	10.1		"	10.0		101	78-126		2.29	30
1,3,5-Trimethylbenzene	9.75		"	10.0		97.5	80-131		1.55	30
1,3-Dichlorobenzene	9.24		"	10.0		92.4	86-122		3.41	30
1,3-Dichloropropane	10.3		"	10.0		103	81-125		0.780	30
1,4-Dichlorobenzene	10.7		"	10.0		107	85-124		1.31	30
2,2-Dichloropropane	7.74		"	10.0		77.4	56-150		0.388	30
2-Chlorotoluene	9.41		"	10.0		94.1	79-130		0.533	30
2-Hexanone	10.1		"	10.0		101	51-146		2.20	30
4-Chlorotoluene	9.52		"	10.0		95.2	79-128		0.950	30
Acetone	8.46		"	10.0		84.6	14-150		1.07	30
Benzene	10.5		"	10.0		105	85-126		2.81	30
Bromobenzene	9.53		"	10.0		95.3	78-129		0.210	30
Bromochloromethane	10.7		"	10.0		107	77-128		2.07	30
Bromodichloromethane	10.3		"	10.0		103	79-128		0.0970	30
Bromoform	9.33		"	10.0		93.3	78-133		0.960	30
Bromomethane	12.5		"	10.0		125	43-168		1.77	30
Carbon tetrachloride	9.93		"	10.0		99.3	77-141		2.39	30
Chlorobenzene	9.85		"	10.0		98.5	88-120		0.713	30
Chloroethane	11.0		"	10.0		110	65-136		5.91	30
Chloroform	10.5		"	10.0		105	82-128		0.759	30
Chloromethane	11.4		"	10.0		114	43-155		1.30	30
cis-1,2-Dichloroethylene	10.2		"	10.0		102	83-129		0.687	30
cis-1,3-Dichloropropylene	9.79		"	10.0		97.9	80-131		1.96	30
Dibromochloromethane	10.0		"	10.0		100	80-130		0.300	30
Dibromomethane	9.84		"	10.0		98.4	72-134		3.41	30
Dichlorodifluoromethane	11.9		"	10.0		119	44-144		0.754	30
Ethyl Benzene	10.1		"	10.0		101	80-131		0.494	30
Hexachlorobutadiene	9.01		"	10.0		90.1	67-146		2.41	30
Isopropylbenzene	9.48		"	10.0		94.8	76-140		0.211	30
Methyl tert-butyl ether (MTBE)	10.6		"	10.0		106	76-135		2.68	30
Methylene chloride	11.7		"	10.0		117	55-137		2.28	30
Naphthalene	9.33		"	10.0		93.3	70-147		1.51	30
n-Butylbenzene	10.2		"	10.0		102	79-132		7.51	30
n-Propylbenzene	9.59		"	10.0		95.9	78-133		0.209	30



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

LCS Dup (BC00345-BSD2)

Prepared: 03/06/2020 Analyzed: 03/07/2020

o-Xylene	9.76		ug/L	10.0		97.6	78-130		0.00	30	
p- & m- Xylenes	20.5		"	20.0		102	77-133		0.681	30	
p-Isopropyltoluene	9.56		"	10.0		95.6	81-136		1.37	30	
sec-Butylbenzene	10.3		"	10.0		103	79-137		1.37	30	
Styrene	10.6		"	10.0		106	67-132		0.659	30	
tert-Butylbenzene	9.34		"	10.0		93.4	77-138		1.62	30	
Tetrachloroethylene	8.18		"	10.0		81.8	82-131	Low Bias	0.245	30	
Toluene	10.3		"	10.0		103	80-127		0.194	30	
trans-1,2-Dichloroethylene	11.2		"	10.0		112	80-132		3.51	30	
trans-1,3-Dichloropropylene	9.92		"	10.0		99.2	78-131		1.93	30	
Trichloroethylene	9.98		"	10.0		99.8	82-128		1.10	30	
Trichlorofluoromethane	9.42		"	10.0		94.2	67-139		7.85	30	
Vinyl Chloride	9.63		"	10.0		96.3	58-145		7.01	30	
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.12</i>		<i>"</i>	<i>10.0</i>		<i>91.2</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.96</i>		<i>"</i>	<i>10.0</i>		<i>99.6</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>9.98</i>		<i>"</i>	<i>10.0</i>		<i>99.8</i>	<i>79-122</i>				



Miscellaneous Physical Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00231 - % Solids Prep

Blank (BC00231-BLK1)


Prepared: 03/04/2020 Analyzed: 03/06/2020

Total Dissolved Solids	ND	10.0	mg/L								
------------------------	----	------	------	--	--	--	--	--	--	--	--



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
20C0057-01	WQ030220:0825 NP2-6	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
20C0057-02	WQ030220:0830 NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

- QR-04 The RPD exceeded control limits for the LCS/LCSD QC.
- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- CCV-E The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

- * Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
- ND NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- LOQ LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
- LOD LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW -846.
- MDL METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
- Reported to This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.
 120 Research Drive Stratford, CT 06615
 132-02 89th Ave Queens, NY 11418
 clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.
20C0057

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone.:	203-929-8555	Phone.:		Phone.:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:		Contact:				RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:	↓	E-mail:		YOUR PO#: 31401451.000 Task 01.00		Standard (5-7 Day) <input checked="" type="checkbox"/>	

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.


Samples Collected by: (print your name above and sign below) <u>Scott Philbrick</u> 	Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp.	
	S - soil / solid	New York	<input checked="" type="checkbox"/>	Summary Report	CT RCP	Standard Excel EDD	Compared to the following Regulation(s): (please fill in)
	GW - groundwater	New Jersey	<input type="checkbox"/>	QA Report	CT RCP DQA/DUE	EQulS (Standard)	
	DW - drinking water	Connecticut	<input type="checkbox"/>	NY ASP A Package	NJDEP Reduced Deliverables	NYSDEC EQulS	
	WW - wastewater	Pennsylvania	<input type="checkbox"/>	NY ASP B Package	NJDEP SRP HazSite		
O - Oil ; Other	Other	<input type="checkbox"/>		NJDKQP	Other:		

Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
<u>WQ0302200825 NP2-6</u>	GW	<u>3-2-20 8:25</u>	VOCs 8260 full list + freon 113	3 HCl VOA
<u>WQ0302200830 NP2-10</u>	GW	<u>3-2-20 8:30</u>	VOCs 8260 full list + freon 113; TDS	3 HCl VOA; 1 plastic

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> HNO3 <input type="checkbox"/> H2SO4 <input type="checkbox"/> NaOH <input type="checkbox"/> ZnAc <input type="checkbox"/> Ascorbic Acid <input type="checkbox"/> Other: <u>Cool</u>	Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/>

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
	<u>3-2-20 16:25</u>				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Temp. Received at Lab
				<u>KBlacogen 3/2/20 16:25</u>	<u>4.0</u> Degrees C

APPENDIX II
MARCH 2020 LABORATORY ANALYTICAL REPORTS
FOR FSP&T RECOVERY WELL



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 03/09/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20C0056

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 03/09/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20C0056

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on March 02, 2020 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries.**

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20C0056-01	WQ030220:0845 NP1-1-2	Water	03/02/2020	03/02/2020

General Notes for York Project (SDG) No.: 20C0056

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 03/09/2020





Sample Information

Client Sample ID: WQ030220:0845 NP1-1-2

York Sample ID: 20C0056-01

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
20C0056	31401451.000 Task 01.00 Rowe Industries	Water	March 2, 2020 8:45 am	03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	03/06/2020 12:30	03/07/2020 05:58	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS



Sample Information

Client Sample ID: WQ030220:0845 NP1-1-2

York Sample ID: 20C0056-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0056

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:45 am

03/02/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS



Sample Information

Client Sample ID: WQ030220:0845 NP1-1-2

York Sample ID: 20C0056-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20C0056

31401451.000 Task 01.00 Rowe Industries

Water

March 2, 2020 8:45 am

03/02/2020


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
127-18-4	Tetrachloroethylene	1.67	CCV-E	ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
79-01-6	Trichloroethylene	0.250		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	03/06/2020 12:30	03/07/2020 05:58	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	03/06/2020 12:30	03/07/2020 05:58	SS
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	96.0 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	99.8 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	105 %	79-122								



Analytical Batch Summary

Batch ID: BC00345

Preparation Method: EPA 5030B

Prepared By: MAT

YORK Sample ID	Client Sample ID	Preparation Date
20C0056-01	WQ030220:0845 NP1-1-2	03/06/20
BC00345-BLK1	Blank	03/06/20
BC00345-BS1	LCS	03/06/20
BC00345-BS2	LCS	03/06/20
BC00345-BSD1	LCS Dup	03/06/20
BC00345-BSD2	LCS Dup	03/06/20



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

Blank (BC00345-BLK1)

Prepared: 03/06/2020 Analyzed: 03/07/2020

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BC00345 - EPA 5030B

Blank (BC00345-BLK1)

Prepared: 03/06/2020 Analyzed: 03/07/2020

n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<hr/>											
Surrogate: SURR: 1,2-Dichloroethane-d4	9.92		"	10.0		99.2	69-130				
Surrogate: SURR: Toluene-d8	9.93		"	10.0		99.3	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.4		"	10.0		104	79-122				

LCS (BC00345-BS1)

Prepared & Analyzed: 03/06/2020

1,1,1,2-Tetrachloroethane	11.4		ug/L	10.0		114	82-126				
1,1,1-Trichloroethane	10.6		"	10.0		106	78-136				
1,1,2,2-Tetrachloroethane	9.32		"	10.0		93.2	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.1		"	10.0		111	54-165				
1,1,2-Trichloroethane	9.70		"	10.0		97.0	82-123				
1,1-Dichloroethane	10.0		"	10.0		100	82-129				
1,1-Dichloroethylene	11.9		"	10.0		119	68-138				
1,1-Dichloropropylene	10.3		"	10.0		103	83-133				
1,2,3-Trichlorobenzene	9.49		"	10.0		94.9	76-136				
1,2,3-Trichloropropane	9.44		"	10.0		94.4	77-128				
1,2,4-Trichlorobenzene	9.50		"	10.0		95.0	76-137				
1,2,4-Trimethylbenzene	9.91		"	10.0		99.1	82-132				
1,2-Dibromo-3-chloropropane	8.68		"	10.0		86.8	45-147				
1,2-Dibromoethane	10.1		"	10.0		101	83-124				
1,2-Dichlorobenzene	9.48		"	10.0		94.8	79-123				
1,2-Dichloroethane	10.2		"	10.0		102	73-132				
1,2-Dichloropropane	9.96		"	10.0		99.6	78-126				
1,3,5-Trimethylbenzene	10.0		"	10.0		100	80-131				
1,3-Dichlorobenzene	9.34		"	10.0		93.4	86-122				
1,3-Dichloropropane	10.1		"	10.0		101	81-125				
1,4-Dichlorobenzene	10.9		"	10.0		109	85-124				
2,2-Dichloropropane	8.00		"	10.0		80.0	56-150				
2-Chlorotoluene	9.73		"	10.0		97.3	79-130				
2-Hexanone	9.69		"	10.0		96.9	51-146				
4-Chlorotoluene	9.70		"	10.0		97.0	79-128				
Acetone	7.99		"	10.0		79.9	14-150				
Benzene	10.6		"	10.0		106	85-126				
Bromobenzene	9.70		"	10.0		97.0	78-129				
Bromochloromethane	10.6		"	10.0		106	77-128				
Bromodichloromethane	10.3		"	10.0		103	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

LCS (BC00345-BS1)

Prepared & Analyzed: 03/06/2020

Bromoform	9.46		ug/L	10.0		94.6	78-133				
Bromomethane	13.2		"	10.0		132	43-168				
Carbon tetrachloride	10.3		"	10.0		103	77-141				
Chlorobenzene	9.83		"	10.0		98.3	88-120				
Chloroethane	15.1		"	10.0		151	65-136	High Bias			
Chloroform	10.5		"	10.0		105	82-128				
Chloromethane	11.4		"	10.0		114	43-155				
cis-1,2-Dichloroethylene	10.0		"	10.0		100	83-129				
cis-1,3-Dichloropropylene	9.73		"	10.0		97.3	80-131				
Dibromochloromethane	9.87		"	10.0		98.7	80-130				
Dibromomethane	9.96		"	10.0		99.6	72-134				
Dichlorodifluoromethane	12.8		"	10.0		128	44-144				
Ethyl Benzene	10.2		"	10.0		102	80-131				
Hexachlorobutadiene	9.32		"	10.0		93.2	67-146				
Isopropylbenzene	9.78		"	10.0		97.8	76-140				
Methyl tert-butyl ether (MTBE)	10.3		"	10.0		103	76-135				
Methylene chloride	11.8		"	10.0		118	55-137				
Naphthalene	9.53		"	10.0		95.3	70-147				
n-Butylbenzene	10.2		"	10.0		102	79-132				
n-Propylbenzene	9.90		"	10.0		99.0	78-133				
o-Xylene	9.81		"	10.0		98.1	78-130				
p- & m- Xylenes	21.1		"	20.0		106	77-133				
p-Isopropyltoluene	9.86		"	10.0		98.6	81-136				
sec-Butylbenzene	10.5		"	10.0		105	79-137				
Styrene	10.7		"	10.0		107	67-132				
tert-Butylbenzene	9.53		"	10.0		95.3	77-138				
Tetrachloroethylene	8.47		"	10.0		84.7	82-131				
Toluene	10.3		"	10.0		103	80-127				
trans-1,2-Dichloroethylene	11.4		"	10.0		114	80-132				
trans-1,3-Dichloropropylene	9.73		"	10.0		97.3	78-131				
Trichloroethylene	10.4		"	10.0		104	82-128				
Trichlorofluoromethane	12.6		"	10.0		126	67-139				
Vinyl Chloride	13.9		"	10.0		139	58-145				
Surrogate: SURRE: 1,2-Dichloroethane-d4	9.30		"	10.0		93.0	69-130				
Surrogate: SURRE: Toluene-d8	10.0		"	10.0		100	81-117				
Surrogate: SURRE: p-Bromofluorobenzene	10.0		"	10.0		100	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	
		Limit							Units	Level

Batch BC00345 - EPA 5030B

LCS (BC00345-BS2)

Prepared: 03/06/2020 Analyzed: 03/07/2020

1,1,1,2-Tetrachloroethane	11.3		ug/L	10.0		113	82-126			
1,1,1-Trichloroethane	10.4		"	10.0		104	78-136			
1,1,2,2-Tetrachloroethane	9.24		"	10.0		92.4	76-129			
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.2		"	10.0		112	54-165			
1,1,2-Trichloroethane	9.94		"	10.0		99.4	82-123			
1,1-Dichloroethane	9.98		"	10.0		99.8	82-129			
1,1-Dichloroethylene	11.8		"	10.0		118	68-138			
1,1-Dichloropropylene	10.3		"	10.0		103	83-133			
1,2,3-Trichlorobenzene	9.01		"	10.0		90.1	76-136			
1,2,3-Trichloropropane	9.38		"	10.0		93.8	77-128			
1,2,4-Trichlorobenzene	8.85		"	10.0		88.5	76-137			
1,2,4-Trimethylbenzene	9.45		"	10.0		94.5	82-132			
1,2-Dibromo-3-chloropropane	8.66		"	10.0		86.6	45-147			
1,2-Dibromoethane	9.81		"	10.0		98.1	83-124			
1,2-Dichlorobenzene	9.15		"	10.0		91.5	79-123			
1,2-Dichloroethane	10.2		"	10.0		102	73-132			
1,2-Dichloropropane	9.91		"	10.0		99.1	78-126			
1,3,5-Trimethylbenzene	9.60		"	10.0		96.0	80-131			
1,3-Dichlorobenzene	8.93		"	10.0		89.3	86-122			
1,3-Dichloropropane	10.2		"	10.0		102	81-125			
1,4-Dichlorobenzene	10.6		"	10.0		106	85-124			
2,2-Dichloropropane	7.71		"	10.0		77.1	56-150			
2-Chlorotoluene	9.36		"	10.0		93.6	79-130			
2-Hexanone	9.91		"	10.0		99.1	51-146			
4-Chlorotoluene	9.43		"	10.0		94.3	79-128			
Acetone	8.37		"	10.0		83.7	14-150			
Benzene	10.8		"	10.0		108	85-126			
Bromobenzene	9.51		"	10.0		95.1	78-129			
Bromochloromethane	10.5		"	10.0		105	77-128			
Bromodichloromethane	10.3		"	10.0		103	79-128			
Bromoform	9.42		"	10.0		94.2	78-133			
Bromomethane	12.3		"	10.0		123	43-168			
Carbon tetrachloride	10.2		"	10.0		102	77-141			
Chlorobenzene	9.78		"	10.0		97.8	88-120			
Chloroethane	11.7		"	10.0		117	65-136			
Chloroform	10.6		"	10.0		106	82-128			
Chloromethane	11.6		"	10.0		116	43-155			
cis-1,2-Dichloroethylene	10.2		"	10.0		102	83-129			
cis-1,3-Dichloropropylene	9.60		"	10.0		96.0	80-131			
Dibromochloromethane	10.0		"	10.0		100	80-130			
Dibromomethane	9.51		"	10.0		95.1	72-134			
Dichlorodifluoromethane	12.0		"	10.0		120	44-144			
Ethyl Benzene	10.1		"	10.0		101	80-131			
Hexachlorobutadiene	9.23		"	10.0		92.3	67-146			
Isopropylbenzene	9.46		"	10.0		94.6	76-140			
Methyl tert-butyl ether (MTBE)	10.3		"	10.0		103	76-135			
Methylene chloride	12.0		"	10.0		120	55-137			
Naphthalene	9.19		"	10.0		91.9	70-147			
n-Butylbenzene	9.49		"	10.0		94.9	79-132			
n-Propylbenzene	9.57		"	10.0		95.7	78-133			



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

LCS (BC00345-BS2)

Prepared: 03/06/2020 Analyzed: 03/07/2020

o-Xylene	9.76		ug/L	10.0		97.6	78-130				
p- & m- Xylenes	20.6		"	20.0		103	77-133				
p-Isopropyltoluene	9.43		"	10.0		94.3	81-136				
sec-Butylbenzene	10.1		"	10.0		101	79-137				
Styrene	10.7		"	10.0		107	67-132				
tert-Butylbenzene	9.19		"	10.0		91.9	77-138				
Tetrachloroethylene	8.16		"	10.0		81.6	82-131	Low Bias			
Toluene	10.3		"	10.0		103	80-127				
trans-1,2-Dichloroethylene	11.6		"	10.0		116	80-132				
trans-1,3-Dichloropropylene	9.73		"	10.0		97.3	78-131				
Trichloroethylene	10.1		"	10.0		101	82-128				
Trichlorofluoromethane	10.2		"	10.0		102	67-139				
Vinyl Chloride	10.3		"	10.0		103	58-145				
Surrogate: SURR: 1,2-Dichloroethane-d4	9.31		"	10.0		93.1	69-130				
Surrogate: SURR: Toluene-d8	9.92		"	10.0		99.2	81-117				
Surrogate: SURR: p-Bromofluorobenzene	9.74		"	10.0		97.4	79-122				

LCS Dup (BC00345-BSD1)

Prepared: 03/06/2020 Analyzed: 03/07/2020

1,1,1,2-Tetrachloroethane	11.2		ug/L	10.0		112	82-126		1.94	30	
1,1,1-Trichloroethane	10.2		"	10.0		102	78-136		3.83	30	
1,1,2,2-Tetrachloroethane	8.93		"	10.0		89.3	76-129		4.27	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.8		"	10.0		108	54-165		2.55	30	
1,1,2-Trichloroethane	9.76		"	10.0		97.6	82-123		0.617	30	
1,1-Dichloroethane	9.87		"	10.0		98.7	82-129		1.61	30	
1,1-Dichloroethylene	11.5		"	10.0		115	68-138		3.59	30	
1,1-Dichloropropylene	10.1		"	10.0		101	83-133		2.35	30	
1,2,3-Trichlorobenzene	8.84		"	10.0		88.4	76-136		7.09	30	
1,2,3-Trichloropropane	9.15		"	10.0		91.5	77-128		3.12	30	
1,2,4-Trichlorobenzene	8.75		"	10.0		87.5	76-137		8.22	30	
1,2,4-Trimethylbenzene	9.22		"	10.0		92.2	82-132		7.21	30	
1,2-Dibromo-3-chloropropane	8.13		"	10.0		81.3	45-147		6.54	30	
1,2-Dibromoethane	9.81		"	10.0		98.1	83-124		2.91	30	
1,2-Dichlorobenzene	8.92		"	10.0		89.2	79-123		6.09	30	
1,2-Dichloroethane	10.2		"	10.0		102	73-132		0.196	30	
1,2-Dichloropropane	9.77		"	10.0		97.7	78-126		1.93	30	
1,3,5-Trimethylbenzene	9.43		"	10.0		94.3	80-131		5.87	30	
1,3-Dichlorobenzene	8.82		"	10.0		88.2	86-122		5.73	30	
1,3-Dichloropropane	9.86		"	10.0		98.6	81-125		2.01	30	
1,4-Dichlorobenzene	10.4		"	10.0		104	85-124		4.52	30	
2,2-Dichloropropane	7.71		"	10.0		77.1	56-150		3.69	30	
2-Chlorotoluene	9.06		"	10.0		90.6	79-130		7.13	30	
2-Hexanone	9.65		"	10.0		96.5	51-146		0.414	30	
4-Chlorotoluene	9.09		"	10.0		90.9	79-128		6.49	30	
Acetone	8.31		"	10.0		83.1	14-150		3.93	30	
Benzene	10.6		"	10.0		106	85-126		0.283	30	
Bromobenzene	9.17		"	10.0		91.7	78-129		5.62	30	
Bromochloromethane	10.5		"	10.0		105	77-128		0.853	30	
Bromodichloromethane	10.0		"	10.0		100	79-128		2.76	30	
Bromoform	9.55		"	10.0		95.5	78-133		0.947	30	
Bromomethane	11.9		"	10.0		119	43-168		10.6	30	



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BC00345 - EPA 5030B											
LCS Dup (BC00345-BSD1)											
						Prepared: 03/06/2020 Analyzed: 03/07/2020					
Carbon tetrachloride	9.93		ug/L	10.0		99.3	77-141		3.56	30	
Chlorobenzene	9.42		"	10.0		94.2	88-120		4.26	30	
Chloroethane	11.5		"	10.0		115	65-136		27.1	30	
Chloroform	10.3		"	10.0		103	82-128		1.15	30	
Chloromethane	11.3		"	10.0		113	43-155		0.968	30	
cis-1,2-Dichloroethylene	9.97		"	10.0		99.7	83-129		0.300	30	
cis-1,3-Dichloropropylene	9.42		"	10.0		94.2	80-131		3.24	30	
Dibromochloromethane	9.75		"	10.0		97.5	80-130		1.22	30	
Dibromomethane	9.29		"	10.0		92.9	72-134		6.96	30	
Dichlorodifluoromethane	12.0		"	10.0		120	44-144		7.10	30	
Ethyl Benzene	9.61		"	10.0		96.1	80-131		6.05	30	
Hexachlorobutadiene	8.82		"	10.0		88.2	67-146		5.51	30	
Isopropylbenzene	9.23		"	10.0		92.3	76-140		5.79	30	
Methyl tert-butyl ether (MTBE)	10.4		"	10.0		104	76-135		0.965	30	
Methylene chloride	11.6		"	10.0		116	55-137		2.14	30	
Naphthalene	9.16		"	10.0		91.6	70-147		3.96	30	
n-Butylbenzene	9.22		"	10.0		92.2	79-132		10.1	30	
n-Propylbenzene	9.17		"	10.0		91.7	78-133		7.66	30	
o-Xylene	9.37		"	10.0		93.7	78-130		4.59	30	
p- & m- Xylenes	19.9		"	20.0		99.4	77-133		6.05	30	
p-Isopropyltoluene	9.17		"	10.0		91.7	81-136		7.25	30	
sec-Butylbenzene	9.86		"	10.0		98.6	79-137		6.67	30	
Styrene	10.4		"	10.0		104	67-132		2.65	30	
tert-Butylbenzene	8.90		"	10.0		89.0	77-138		6.84	30	
Tetrachloroethylene	8.04		"	10.0		80.4	82-131	Low Bias	5.21	30	
Toluene	9.87		"	10.0		98.7	80-127		4.55	30	
trans-1,2-Dichloroethylene	11.1		"	10.0		111	80-132		2.50	30	
trans-1,3-Dichloropropylene	9.62		"	10.0		96.2	78-131		1.14	30	
Trichloroethylene	9.89		"	10.0		98.9	82-128		5.51	30	
Trichlorofluoromethane	10.1		"	10.0		101	67-139		21.8	30	
Vinyl Chloride	10.3		"	10.0		103	58-145		30.3	30	Non-dir.
Surrogate: SURR: 1,2-Dichloroethane-d4	9.73		"	10.0		97.3	69-130				
Surrogate: SURR: Toluene-d8	10.0		"	10.0		100	81-117				
Surrogate: SURR: p-Bromofluorobenzene	9.94		"	10.0		99.4	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting		Spike	Source*	%REC	%REC	Limits	Flag	RPD	
		Limit	Units							Level	Result
Batch BC00345 - EPA 5030B											
LCS Dup (BC00345-BSD2)											
						Prepared: 03/06/2020 Analyzed: 03/07/2020					
1,1,1,2-Tetrachloroethane	11.2		ug/L	10.0		112	82-126			0.710	30
1,1,1-Trichloroethane	10.3		"	10.0		103	78-136			0.290	30
1,1,2,2-Tetrachloroethane	9.50		"	10.0		95.0	76-129			2.77	30
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.9		"	10.0		109	54-165			1.99	30
1,1,2-Trichloroethane	10.0		"	10.0		100	82-123			0.702	30
1,1-Dichloroethane	10.0		"	10.0		100	82-129			0.200	30
1,1-Dichloroethylene	11.6		"	10.0		116	68-138			1.54	30
1,1-Dichloropropylene	10.3		"	10.0		103	83-133			0.388	30
1,2,3-Trichlorobenzene	9.34		"	10.0		93.4	76-136			3.60	30
1,2,3-Trichloropropane	9.36		"	10.0		93.6	77-128			0.213	30
1,2,4-Trichlorobenzene	9.32		"	10.0		93.2	76-137			5.17	30
1,2,4-Trimethylbenzene	9.48		"	10.0		94.8	82-132			0.317	30
1,2-Dibromo-3-chloropropane	8.83		"	10.0		88.3	45-147			1.94	30
1,2-Dibromoethane	10.2		"	10.0		102	83-124			4.19	30
1,2-Dichlorobenzene	9.27		"	10.0		92.7	79-123			1.30	30
1,2-Dichloroethane	10.2		"	10.0		102	73-132			0.196	30
1,2-Dichloropropane	10.1		"	10.0		101	78-126			2.29	30
1,3,5-Trimethylbenzene	9.75		"	10.0		97.5	80-131			1.55	30
1,3-Dichlorobenzene	9.24		"	10.0		92.4	86-122			3.41	30
1,3-Dichloropropane	10.3		"	10.0		103	81-125			0.780	30
1,4-Dichlorobenzene	10.7		"	10.0		107	85-124			1.31	30
2,2-Dichloropropane	7.74		"	10.0		77.4	56-150			0.388	30
2-Chlorotoluene	9.41		"	10.0		94.1	79-130			0.533	30
2-Hexanone	10.1		"	10.0		101	51-146			2.20	30
4-Chlorotoluene	9.52		"	10.0		95.2	79-128			0.950	30
Acetone	8.46		"	10.0		84.6	14-150			1.07	30
Benzene	10.5		"	10.0		105	85-126			2.81	30
Bromobenzene	9.53		"	10.0		95.3	78-129			0.210	30
Bromochloromethane	10.7		"	10.0		107	77-128			2.07	30
Bromodichloromethane	10.3		"	10.0		103	79-128			0.0970	30
Bromoform	9.33		"	10.0		93.3	78-133			0.960	30
Bromomethane	12.5		"	10.0		125	43-168			1.77	30
Carbon tetrachloride	9.93		"	10.0		99.3	77-141			2.39	30
Chlorobenzene	9.85		"	10.0		98.5	88-120			0.713	30
Chloroethane	11.0		"	10.0		110	65-136			5.91	30
Chloroform	10.5		"	10.0		105	82-128			0.759	30
Chloromethane	11.4		"	10.0		114	43-155			1.30	30
cis-1,2-Dichloroethylene	10.2		"	10.0		102	83-129			0.687	30
cis-1,3-Dichloropropylene	9.79		"	10.0		97.9	80-131			1.96	30
Dibromochloromethane	10.0		"	10.0		100	80-130			0.300	30
Dibromomethane	9.84		"	10.0		98.4	72-134			3.41	30
Dichlorodifluoromethane	11.9		"	10.0		119	44-144			0.754	30
Ethyl Benzene	10.1		"	10.0		101	80-131			0.494	30
Hexachlorobutadiene	9.01		"	10.0		90.1	67-146			2.41	30
Isopropylbenzene	9.48		"	10.0		94.8	76-140			0.211	30
Methyl tert-butyl ether (MTBE)	10.6		"	10.0		106	76-135			2.68	30
Methylene chloride	11.7		"	10.0		117	55-137			2.28	30
Naphthalene	9.33		"	10.0		93.3	70-147			1.51	30
n-Butylbenzene	10.2		"	10.0		102	79-132			7.51	30
n-Propylbenzene	9.59		"	10.0		95.9	78-133			0.209	30



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BC00345 - EPA 5030B

LCS Dup (BC00345-BSD2)


Prepared: 03/06/2020 Analyzed: 03/07/2020

o-Xylene	9.76		ug/L	10.0		97.6	78-130		0.00	30	
p- & m- Xylenes	20.5		"	20.0		102	77-133		0.681	30	
p-Isopropyltoluene	9.56		"	10.0		95.6	81-136		1.37	30	
sec-Butylbenzene	10.3		"	10.0		103	79-137		1.37	30	
Styrene	10.6		"	10.0		106	67-132		0.659	30	
tert-Butylbenzene	9.34		"	10.0		93.4	77-138		1.62	30	
Tetrachloroethylene	8.18		"	10.0		81.8	82-131	Low Bias	0.245	30	
Toluene	10.3		"	10.0		103	80-127		0.194	30	
trans-1,2-Dichloroethylene	11.2		"	10.0		112	80-132		3.51	30	
trans-1,3-Dichloropropylene	9.92		"	10.0		99.2	78-131		1.93	30	
Trichloroethylene	9.98		"	10.0		99.8	82-128		1.10	30	
Trichlorofluoromethane	9.42		"	10.0		94.2	67-139		7.85	30	
Vinyl Chloride	9.63		"	10.0		96.3	58-145		7.01	30	
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.12</i>		<i>"</i>	<i>10.0</i>		<i>91.2</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.96</i>		<i>"</i>	<i>10.0</i>		<i>99.6</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>9.98</i>		<i>"</i>	<i>10.0</i>		<i>99.8</i>	<i>79-122</i>				



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
20C0056-01	WQ030220:0845 NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

- QR-04 The RPD exceeded control limits for the LCS/LCSD QC.
- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- CCV-E The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

- * Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
- ND NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- LOQ LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
- LOD LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW -846.
- MDL METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
- Reported to This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.

10182 20A038 20A0763 A0959 80915

60184 60195



York Analytical Laboratories, Inc.
 120 Research Drive 132-02 89th Ave
 Stratford, CT 06615 Queens, NY 11418
 clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.
20C0056
 Page 1 of 1

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone:	203-929-8555	Phone:		Phone:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:		Contact:				RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:		E-mail:		YOUR PO#: 31401451.000 Task 01.00		Standard (5-7 Day) <input checked="" type="checkbox"/>	

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.

Samples Collected by: (print your name above and sign below) Scott Philbrick	Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp. Compared to the following Regulation(s): (please fill in)	
	S - soil / solid	New York	<input checked="" type="checkbox"/>	Summary Report	CT RCP		Standard Excel EDD
	GW - groundwater	New Jersey		QA Report	CT RCP DQA/DUE		EQulS (Standard)
	DW - drinking water	Connecticut		NY ASP A Package	NJDEP Reduced Deliverables		NYSDEC EQulS
	WW - wastewater	Pennsylvania		NY ASP B Package	NJDEP SRP HazSite		
O - Oil ; Other	Other			NJDKQP	Other:		

Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
WQ 030220:0845 NPI-1-2	GW	3-2-20 8:45	VOCs 8260 full list + freon 113	3 HCl VOA
	↓			

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH ___ HNO ₃ ___ H ₂ SO ₄ ___ NaOH ___ ZnAc ___ Ascorbic Acid ___ Other: <u>Cool</u>	Field Filtered ___ Lab to Filter ___

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
	3-2-20 16:25				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received In LAB by	Date/Time
				KBlocker	3/2/20 1625
					Temp. Received at Lab 4.0 Degrees C