

TABLE 2

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Effluent Water Quality Results

Date Sampled ^{2/}	pH ^{1/}	TDS ^{4/} (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis- 1,2-DCE (ug/l)	trans- 1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethyl- benzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	6.5 to 8.5	---	5	5	5	5	5	5	5	5	5	5	5	---	10	7	---	---
4-Jun-19	6.0	139	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.620	ND<0.278
2-Jul-19	6.0	145	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	1.82 C,Q,B	ND<0.5	0.766	ND<0.278
1-Aug-19	6.8	168	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	1.30	1.24
5-Sep-19	6.8	172	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.291	ND<0.278
3-Oct-19	6.5	165	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.612	ND<0.278
4-Nov-19	6.0	102	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.536	ND<0.278
5-Dec-19	6.8	129	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
7-Jan-20	6.8	175	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
4-Feb-20	7.0	122	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
2-Mar-20	7.0	137	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
2-Apr-20	7.0	161	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
7-May-20	7.0	299	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected NA: Not Analyzed

C = CCV-E: The value reported is estimated. The value is estimated due to its behavior during continuing calibration verification.


Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

Notes:


- Based on the SPDES criteria from an NYSDEC letter dated on May 6, 2016, the allowable pH range for the Rowe Site is between 6.5 and 8.5. The effluent pH was 7.0 on May 18, 2020. Historic pH measurements from recovery wells indicate that natural background pH concentrations are less than 6.5.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- Starting in October 2016, FSP&T system samples are collected monthly instead of once every two weeks. The pH of the effluent water is measured two times per month in accordance with the SPDES requirements.

GRAPH 1
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

Effluent Flow Data
(May 1, 2020 to May 31, 2020)

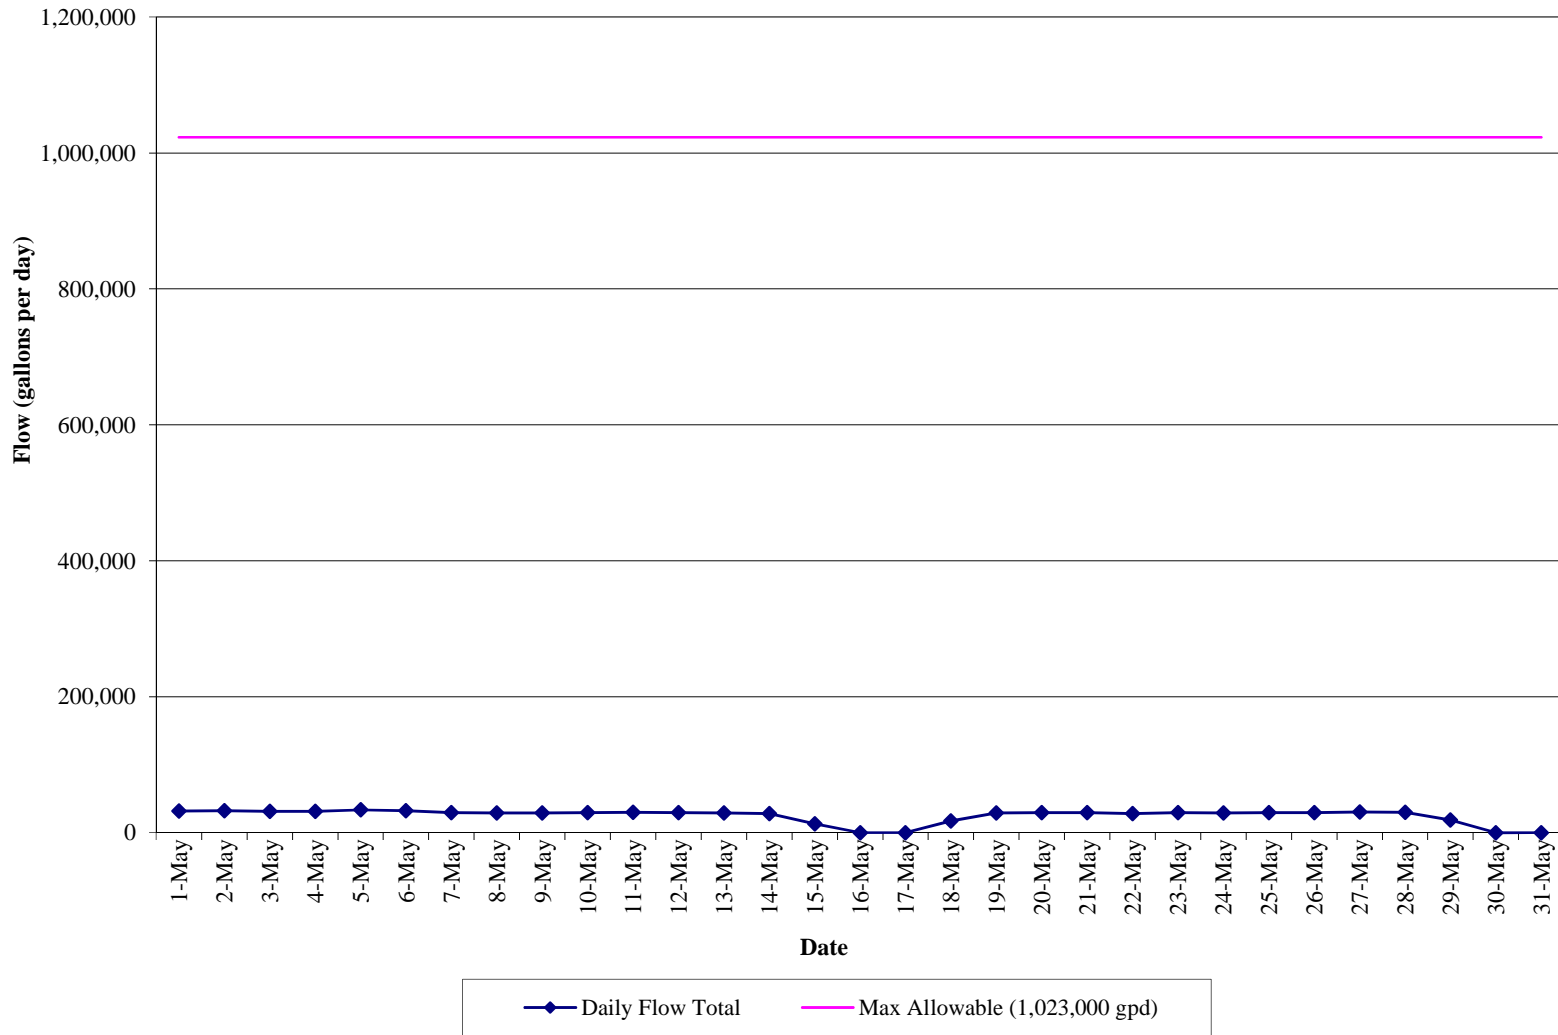

APPENDIX I
MAY 2020 LABORATORY ANALYTICAL REPORT
FOR FSP&T SYSTEM



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 05/14/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20E0223

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 05/14/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20E0223

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on May 08, 2020 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20E0223-01	WQ050720:1025 NP2-6	Water	05/07/2020	05/08/2020
20E0223-02	WQ050720:1030 NP2-10	Water	05/07/2020	05/08/2020

General Notes for York Project (SDG) No.: 20E0223

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 05/14/2020





Sample Information

Client Sample ID: WQ050720:1025 NP2-6

York Sample ID: 20E0223-01

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
20E0223	31401451.000 Task 01.00 Rowe Industries	Water	May 7, 2020 10:25 am	05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	05/11/2020 09:30	05/11/2020 13:27	RB
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB



Sample Information

Client Sample ID: WQ050720:1025 NP2-6

York Sample ID: 20E0223-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0223

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:25 am

05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB



Sample Information

Client Sample ID: WQ050720:1025 NP2-6

York Sample ID: 20E0223-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0223

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:25 am

05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
79-01-6	Trichloroethylene	0.200		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:27	RB
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	05/11/2020 09:30	05/11/2020 13:27	RB
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	92.4 %			69-130						
2037-26-5	Surrogate: SURRE: Toluene-d8	92.5 %			81-117						
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	107 %			79-122						



Sample Information

Client Sample ID: WQ050720:1030 NP2-10

York Sample ID: 20E0223-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0223

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:30 am

05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	05/11/2020 09:30	05/11/2020 13:56	RB
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB



Sample Information

Client Sample ID: WQ050720:1030 NP2-10

York Sample ID: 20E0223-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0223

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:30 am

05/08/2020


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB



Sample Information

Client Sample ID: WQ050720:1030 NP2-10

York Sample ID: 20E0223-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0223

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:30 am

05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B


CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 13:56	RB
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	05/11/2020 09:30	05/11/2020 13:56	RB

	Surrogate Recoveries	Result	Acceptance Range
17060-07-0	Surrogate: SURR: 1,2-Dichloroethane-d4	92.9 %	69-130
2037-26-5	Surrogate: SURR: Toluene-d8	93.2 %	81-117
460-00-4	Surrogate: SURR: p-Bromofluorobenzene	111 %	79-122

Total Dissolved Solids

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: WQ050720:1030 NP2-10

York Sample ID: 20E0223-02

York Project (SDG) No. 20E0223

Client Project ID 31401451.000 Task 01.00 Rowe Industries


Matrix Water

Collection Date/Time May 7, 2020 10:30 am

Date Received 05/08/2020

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	299		mg/L	10.0	1	SM 2540C	05/13/2020 15:34	05/14/2020 18:30	AA
							Certifications:	NELAC-NY10854,CTDOH,NJDEP,PADEP		



Analytical Batch Summary

Batch ID: BE00379

Preparation Method: EPA 5030B

Prepared By: CLS2

YORK Sample ID	Client Sample ID	Preparation Date
20E0223-01	WQ050720:1025 NP2-6	05/11/20
20E0223-02	WQ050720:1030 NP2-10	05/11/20
BE00379-BLK1	Blank	05/11/20
BE00379-BS1	LCS	05/11/20
BE00379-BSD1	LCS Dup	05/11/20

Batch ID: BE00542

Preparation Method: % Solids Prep

Prepared By: AA

YORK Sample ID	Client Sample ID	Preparation Date
20E0223-02	WQ050720:1030 NP2-10	05/13/20
BE00542-BLK1	Blank	05/13/20
BE00542-DUP1	Duplicate	05/13/20



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BE00379 - EPA 5030B

Blank (BE00379-BLK1)

Prepared & Analyzed: 05/11/2020

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	
Batch BE00379 - EPA 5030B											
Blank (BE00379-BLK1)										Prepared & Analyzed: 05/11/2020	
n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.04</i>		<i>"</i>	<i>10.0</i>		<i>90.4</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.44</i>		<i>"</i>	<i>10.0</i>		<i>94.4</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>10.7</i>		<i>"</i>	<i>10.0</i>		<i>107</i>	<i>79-122</i>				
LCS (BE00379-BS1)										Prepared & Analyzed: 05/11/2020	
1,1,1,2-Tetrachloroethane	10.5		ug/L	10.0		105	82-126				
1,1,1-Trichloroethane	12.7		"	10.0		127	78-136				
1,1,2,2-Tetrachloroethane	9.72		"	10.0		97.2	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	14.5		"	10.0		145	54-165				
1,1,2-Trichloroethane	10.3		"	10.0		103	82-123				
1,1-Dichloroethane	11.2		"	10.0		112	82-129				
1,1-Dichloroethylene	12.6		"	10.0		126	68-138				
1,1-Dichloropropylene	11.9		"	10.0		119	83-133				
1,2,3-Trichlorobenzene	10.2		"	10.0		102	76-136				
1,2,3-Trichloropropane	10.2		"	10.0		102	77-128				
1,2,4-Trichlorobenzene	10.0		"	10.0		100	76-137				
1,2,4-Trimethylbenzene	10.3		"	10.0		103	82-132				
1,2-Dibromo-3-chloropropane	9.62		"	10.0		96.2	45-147				
1,2-Dibromoethane	10.8		"	10.0		108	83-124				
1,2-Dichlorobenzene	9.98		"	10.0		99.8	79-123				
1,2-Dichloroethane	10.9		"	10.0		109	73-132				
1,2-Dichloropropane	9.73		"	10.0		97.3	78-126				
1,3,5-Trimethylbenzene	10.6		"	10.0		106	80-131				
1,3-Dichlorobenzene	10.0		"	10.0		100	86-122				
1,3-Dichloropropane	9.99		"	10.0		99.9	81-125				
1,4-Dichlorobenzene	9.85		"	10.0		98.5	85-124				
2,2-Dichloropropane	12.6		"	10.0		126	56-150				
2-Chlorotoluene	9.85		"	10.0		98.5	79-130				
2-Hexanone	9.66		"	10.0		96.6	51-146				
4-Chlorotoluene	9.83		"	10.0		98.3	79-128				
Acetone	9.87		"	10.0		98.7	14-150				
Benzene	12.2		"	10.0		122	85-126				
Bromobenzene	9.63		"	10.0		96.3	78-129				
Bromochloromethane	11.1		"	10.0		111	77-128				
Bromodichloromethane	10.2		"	10.0		102	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BE00379 - EPA 5030B

LCS (BE00379-BS1)

Prepared & Analyzed: 05/11/2020

Bromoform	10.0		ug/L	10.0		100		78-133			
Bromomethane	10.5		"	10.0		105		43-168			
Carbon tetrachloride	12.3		"	10.0		123		77-141			
Chlorobenzene	10.3		"	10.0		103		88-120			
Chloroethane	10.1		"	10.0		101		65-136			
Chloroform	11.8		"	10.0		118		82-128			
Chloromethane	11.1		"	10.0		111		43-155			
cis-1,2-Dichloroethylene	11.6		"	10.0		116		83-129			
cis-1,3-Dichloropropylene	10.3		"	10.0		103		80-131			
Dibromochloromethane	10.9		"	10.0		109		80-130			
Dibromomethane	10.2		"	10.0		102		72-134			
Dichlorodifluoromethane	15.3		"	10.0		153		44-144	High Bias		
Ethyl Benzene	10.3		"	10.0		103		80-131			
Hexachlorobutadiene	10.4		"	10.0		104		67-146			
Isopropylbenzene	10.2		"	10.0		102		76-140			
Methyl tert-butyl ether (MTBE)	12.2		"	10.0		122		76-135			
Methylene chloride	11.6		"	10.0		116		55-137			
Naphthalene	10.8		"	10.0		108		70-147			
n-Butylbenzene	9.28		"	10.0		92.8		79-132			
n-Propylbenzene	9.99		"	10.0		99.9		78-133			
o-Xylene	9.98		"	10.0		99.8		78-130			
p- & m- Xylenes	20.5		"	20.0		102		77-133			
p-Isopropyltoluene	10.6		"	10.0		106		81-136			
sec-Butylbenzene	10.9		"	10.0		109		79-137			
Styrene	10.3		"	10.0		103		67-132			
tert-Butylbenzene	10.2		"	10.0		102		77-138			
Tetrachloroethylene	9.19		"	10.0		91.9		82-131			
Toluene	10.5		"	10.0		105		80-127			
trans-1,2-Dichloroethylene	12.4		"	10.0		124		80-132			
trans-1,3-Dichloropropylene	9.83		"	10.0		98.3		78-131			
Trichloroethylene	10.8		"	10.0		108		82-128			
Trichlorofluoromethane	10.2		"	10.0		102		67-139			
Vinyl Chloride	10.3		"	10.0		103		58-145			
<i>Surrogate: SURRE: 1,2-Dichloroethane-d4</i>	<i>9.11</i>		<i>"</i>	<i>10.0</i>		<i>91.1</i>		<i>69-130</i>			
<i>Surrogate: SURRE: Toluene-d8</i>	<i>9.18</i>		<i>"</i>	<i>10.0</i>		<i>91.8</i>		<i>81-117</i>			
<i>Surrogate: SURRE: p-Bromofluorobenzene</i>	<i>10.2</i>		<i>"</i>	<i>10.0</i>		<i>102</i>		<i>79-122</i>			



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BE00379 - EPA 5030B											
LCS Dup (BE00379-BSD1)											
Prepared & Analyzed: 05/11/2020											
1,1,1,2-Tetrachloroethane	10.0		ug/L	10.0		100	82-126		4.39	30	
1,1,1-Trichloroethane	12.2		"	10.0		122	78-136		4.01	30	
1,1,2,2-Tetrachloroethane	9.39		"	10.0		93.9	76-129		3.45	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	14.4		"	10.0		144	54-165		1.25	30	
1,1,2-Trichloroethane	10.0		"	10.0		100	82-123		2.84	30	
1,1-Dichloroethane	11.0		"	10.0		110	82-129		1.79	30	
1,1-Dichloroethylene	12.4		"	10.0		124	68-138		1.36	30	
1,1-Dichloropropylene	11.6		"	10.0		116	83-133		2.30	30	
1,2,3-Trichlorobenzene	10.1		"	10.0		101	76-136		1.48	30	
1,2,3-Trichloropropane	9.99		"	10.0		99.9	77-128		2.47	30	
1,2,4-Trichlorobenzene	10.2		"	10.0		102	76-137		1.58	30	
1,2,4-Trimethylbenzene	9.91		"	10.0		99.1	82-132		3.47	30	
1,2-Dibromo-3-chloropropane	9.81		"	10.0		98.1	45-147		1.96	30	
1,2-Dibromoethane	10.7		"	10.0		107	83-124		0.835	30	
1,2-Dichlorobenzene	9.67		"	10.0		96.7	79-123		3.16	30	
1,2-Dichloroethane	10.8		"	10.0		108	73-132		1.57	30	
1,2-Dichloropropane	9.47		"	10.0		94.7	78-126		2.71	30	
1,3,5-Trimethylbenzene	10.1		"	10.0		101	80-131		5.03	30	
1,3-Dichlorobenzene	9.69		"	10.0		96.9	86-122		3.45	30	
1,3-Dichloropropane	9.83		"	10.0		98.3	81-125		1.61	30	
1,4-Dichlorobenzene	9.40		"	10.0		94.0	85-124		4.68	30	
2,2-Dichloropropane	12.1		"	10.0		121	56-150		4.22	30	
2-Chlorotoluene	9.45		"	10.0		94.5	79-130		4.15	30	
2-Hexanone	9.60		"	10.0		96.0	51-146		0.623	30	
4-Chlorotoluene	9.54		"	10.0		95.4	79-128		2.99	30	
Acetone	9.66		"	10.0		96.6	14-150		2.15	30	
Benzene	12.1		"	10.0		121	85-126		0.329	30	
Bromobenzene	9.38		"	10.0		93.8	78-129		2.63	30	
Bromochloromethane	11.1		"	10.0		111	77-128		0.00	30	
Bromodichloromethane	9.96		"	10.0		99.6	79-128		2.48	30	
Bromoform	10.1		"	10.0		101	78-133		0.498	30	
Bromomethane	10.6		"	10.0		106	43-168		1.24	30	
Carbon tetrachloride	11.9		"	10.0		119	77-141		3.06	30	
Chlorobenzene	10.1		"	10.0		101	88-120		1.77	30	
Chloroethane	9.91		"	10.0		99.1	65-136		1.90	30	
Chloroform	11.7		"	10.0		117	82-128		0.426	30	
Chloromethane	11.1		"	10.0		111	43-155		0.180	30	
cis-1,2-Dichloroethylene	11.4		"	10.0		114	83-129		1.48	30	
cis-1,3-Dichloropropylene	10.1		"	10.0		101	80-131		2.65	30	
Dibromochloromethane	10.7		"	10.0		107	80-130		1.66	30	
Dibromomethane	10.0		"	10.0		100	72-134		1.78	30	
Dichlorodifluoromethane	14.9		"	10.0		149	44-144	High Bias	2.84	30	
Ethyl Benzene	9.99		"	10.0		99.9	80-131		3.06	30	
Hexachlorobutadiene	9.97		"	10.0		99.7	67-146		4.32	30	
Isopropylbenzene	9.79		"	10.0		97.9	76-140		3.91	30	
Methyl tert-butyl ether (MTBE)	12.1		"	10.0		121	76-135		0.329	30	
Methylene chloride	11.5		"	10.0		115	55-137		1.04	30	
Naphthalene	10.8		"	10.0		108	70-147		0.0930	30	
n-Butylbenzene	8.90		"	10.0		89.0	79-132		4.18	30	
n-Propylbenzene	9.49		"	10.0		94.9	78-133		5.13	30	



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BE00379 - EPA 5030B

LCS Dup (BE00379-BSD1)


Prepared & Analyzed: 05/11/2020

o-Xylene	9.82		ug/L	10.0		98.2	78-130		1.62	30	
p- & m- Xylenes	20.0		"	20.0		99.9	77-133		2.57	30	
p-Isopropyltoluene	10.2		"	10.0		102	81-136		3.36	30	
sec-Butylbenzene	10.5		"	10.0		105	79-137		4.30	30	
Styrene	10.2		"	10.0		102	67-132		1.66	30	
tert-Butylbenzene	9.89		"	10.0		98.9	77-138		2.99	30	
Tetrachloroethylene	8.98		"	10.0		89.8	82-131		2.31	30	
Toluene	10.2		"	10.0		102	80-127		2.32	30	
trans-1,2-Dichloroethylene	12.2		"	10.0		122	80-132		1.30	30	
trans-1,3-Dichloropropylene	9.58		"	10.0		95.8	78-131		2.58	30	
Trichloroethylene	10.4		"	10.0		104	82-128		4.16	30	
Trichlorofluoromethane	9.89		"	10.0		98.9	67-139		2.59	30	
Vinyl Chloride	9.87		"	10.0		98.7	58-145		4.55	30	
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.08</i>		<i>"</i>	<i>10.0</i>		<i>90.8</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.06</i>		<i>"</i>	<i>10.0</i>		<i>90.6</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>10.1</i>		<i>"</i>	<i>10.0</i>		<i>101</i>	<i>79-122</i>				



Miscellaneous Physical Parameters - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BE00542 - % Solids Prep											
Blank (BE00542-BLK1)											
Total Dissolved Solids	ND	10.0	mg/L								Prepared: 05/13/2020 Analyzed: 05/14/2020
Duplicate (BE00542-DUP1)											
*Source sample: 20E0223-02 (WQ050720:1030 NP2-10)											
Total Dissolved Solids	300	10.0	mg/L		299				0.334	15	



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
20E0223-01	WQ050720:1025 NP2-6	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
20E0223-02	WQ050720:1030 NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- CCV-E The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

- * Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
- ND NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- LOQ LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
- LOD LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
- MDL METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
- Reported to This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.
 120 Research Drive Stratford, CT 06615
 132-02 89th Ave Queens, NY 11418
 clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.
 20E0223

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone.:	203-929-8555	Phone.:		Phone.:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:		Contact:				RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:	↓	E-mail:		YOUR PO#: 31401451.000 Task 01.00		Standard (5-7 Day) X	

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.

Samples Collected by: (print your name above and sign below) <i>Scott Philbrick</i> <i>Scott Philbrick</i>	Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp.
	S - soil / solid	New York	X	Summary Report	CT RCP	Standard Excel EDD
GW - groundwater	New Jersey		QA Report	CT RCP DQA/DUE	EQulS (Standard)	Compared to the following Regulation(s): (please fill in)
DW - drinking water	Connecticut		NY ASP A Package	NJDEP Reduced Deliverables	NYSDEC EQulS	
WW - wastewater	Pennsylvania		NY ASP B Package		NJDEP SRP HazSite	
O - Oil ; Other	Other			NJDKQP	Other:	


Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
WQ050720: 1025 NP2-6	GW	5-7-20 10:25	VOCs 8260 full list + freon 113	3 HCl VOA
WQ050720: 1032 NP2-10	GW	5-7-20 10:38	VOCs 8260 full list + freon 113; TDS	3 HCl VOA; 1 plastic

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH ___ HNO ₃ ___ H ₂ SO ₄ ___ NaOH ___ ZnAc ___ Ascorbic Acid ___ Other: <i>cool</i>	Field Filtered ___ Lab to Filter ___

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
<i>WSP</i>	5-8-20 11:25				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Date/Time
				<i>TGA</i>	5/8/2020 11:25
					4.7

Degrees C

APPENDIX II
MAY 2020 LABORATORY ANALYTICAL REPORTS
FOR FSP&T RECOVERY WELL



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 05/12/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20E0221

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 05/12/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20E0221

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on May 08, 2020 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20E0221-01	WQ050720:1015 NP1-1-2	Water	05/07/2020	05/08/2020

General Notes for York Project (SDG) No.: 20E0221

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 05/12/2020





Sample Information

Client Sample ID: WQ050720:1015 NP1-1-2

York Sample ID: 20E0221-01

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
20E0221	31401451.000 Task 01.00 Rowe Industries	Water	May 7, 2020 10:15 am	05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	05/11/2020 09:30	05/11/2020 12:57	RB
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB



Sample Information

Client Sample ID: WQ050720:1015 NP1-1-2

York Sample ID: 20E0221-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0221

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:15 am

05/08/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
67-66-3	Chloroform	0.210		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB



Sample Information

Client Sample ID: WQ050720:1015 NP1-1-2

York Sample ID: 20E0221-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20E0221

31401451.000 Task 01.00 Rowe Industries

Water

May 7, 2020 10:15 am

05/08/2020


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
79-01-6	Trichloroethylene	0.240		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	05/11/2020 09:30	05/11/2020 12:57	RB
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	05/11/2020 09:30	05/11/2020 12:57	RB
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	92.6 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	92.2 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	110 %	79-122								



Analytical Batch Summary

Batch ID: BE00379

Preparation Method: EPA 5030B

Prepared By: CLS2

YORK Sample ID	Client Sample ID	Preparation Date
20E0221-01	WQ050720:1015 NP1-1-2	05/11/20
BE00379-BLK1	Blank	05/11/20
BE00379-BS1	LCS	05/11/20
BE00379-BSD1	LCS Dup	05/11/20



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BE00379 - EPA 5030B

Blank (BE00379-BLK1)

Prepared & Analyzed: 05/11/2020

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	
Batch BE00379 - EPA 5030B											
Blank (BE00379-BLK1)										Prepared & Analyzed: 05/11/2020	
n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.04</i>		<i>"</i>	<i>10.0</i>		<i>90.4</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.44</i>		<i>"</i>	<i>10.0</i>		<i>94.4</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>10.7</i>		<i>"</i>	<i>10.0</i>		<i>107</i>	<i>79-122</i>				
LCS (BE00379-BS1)										Prepared & Analyzed: 05/11/2020	
1,1,1,2-Tetrachloroethane	10.5		ug/L	10.0		105	82-126				
1,1,1-Trichloroethane	12.7		"	10.0		127	78-136				
1,1,2,2-Tetrachloroethane	9.72		"	10.0		97.2	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	14.5		"	10.0		145	54-165				
1,1,2-Trichloroethane	10.3		"	10.0		103	82-123				
1,1-Dichloroethane	11.2		"	10.0		112	82-129				
1,1-Dichloroethylene	12.6		"	10.0		126	68-138				
1,1-Dichloropropylene	11.9		"	10.0		119	83-133				
1,2,3-Trichlorobenzene	10.2		"	10.0		102	76-136				
1,2,3-Trichloropropane	10.2		"	10.0		102	77-128				
1,2,4-Trichlorobenzene	10.0		"	10.0		100	76-137				
1,2,4-Trimethylbenzene	10.3		"	10.0		103	82-132				
1,2-Dibromo-3-chloropropane	9.62		"	10.0		96.2	45-147				
1,2-Dibromoethane	10.8		"	10.0		108	83-124				
1,2-Dichlorobenzene	9.98		"	10.0		99.8	79-123				
1,2-Dichloroethane	10.9		"	10.0		109	73-132				
1,2-Dichloropropane	9.73		"	10.0		97.3	78-126				
1,3,5-Trimethylbenzene	10.6		"	10.0		106	80-131				
1,3-Dichlorobenzene	10.0		"	10.0		100	86-122				
1,3-Dichloropropane	9.99		"	10.0		99.9	81-125				
1,4-Dichlorobenzene	9.85		"	10.0		98.5	85-124				
2,2-Dichloropropane	12.6		"	10.0		126	56-150				
2-Chlorotoluene	9.85		"	10.0		98.5	79-130				
2-Hexanone	9.66		"	10.0		96.6	51-146				
4-Chlorotoluene	9.83		"	10.0		98.3	79-128				
Acetone	9.87		"	10.0		98.7	14-150				
Benzene	12.2		"	10.0		122	85-126				
Bromobenzene	9.63		"	10.0		96.3	78-129				
Bromochloromethane	11.1		"	10.0		111	77-128				
Bromodichloromethane	10.2		"	10.0		102	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BE00379 - EPA 5030B

LCS (BE00379-BS1)

Prepared & Analyzed: 05/11/2020

Bromoform	10.0		ug/L	10.0		100	78-133				
Bromomethane	10.5		"	10.0		105	43-168				
Carbon tetrachloride	12.3		"	10.0		123	77-141				
Chlorobenzene	10.3		"	10.0		103	88-120				
Chloroethane	10.1		"	10.0		101	65-136				
Chloroform	11.8		"	10.0		118	82-128				
Chloromethane	11.1		"	10.0		111	43-155				
cis-1,2-Dichloroethylene	11.6		"	10.0		116	83-129				
cis-1,3-Dichloropropylene	10.3		"	10.0		103	80-131				
Dibromochloromethane	10.9		"	10.0		109	80-130				
Dibromomethane	10.2		"	10.0		102	72-134				
Dichlorodifluoromethane	15.3		"	10.0		153	44-144	High Bias			
Ethyl Benzene	10.3		"	10.0		103	80-131				
Hexachlorobutadiene	10.4		"	10.0		104	67-146				
Isopropylbenzene	10.2		"	10.0		102	76-140				
Methyl tert-butyl ether (MTBE)	12.2		"	10.0		122	76-135				
Methylene chloride	11.6		"	10.0		116	55-137				
Naphthalene	10.8		"	10.0		108	70-147				
n-Butylbenzene	9.28		"	10.0		92.8	79-132				
n-Propylbenzene	9.99		"	10.0		99.9	78-133				
o-Xylene	9.98		"	10.0		99.8	78-130				
p- & m- Xylenes	20.5		"	20.0		102	77-133				
p-Isopropyltoluene	10.6		"	10.0		106	81-136				
sec-Butylbenzene	10.9		"	10.0		109	79-137				
Styrene	10.3		"	10.0		103	67-132				
tert-Butylbenzene	10.2		"	10.0		102	77-138				
Tetrachloroethylene	9.19		"	10.0		91.9	82-131				
Toluene	10.5		"	10.0		105	80-127				
trans-1,2-Dichloroethylene	12.4		"	10.0		124	80-132				
trans-1,3-Dichloropropylene	9.83		"	10.0		98.3	78-131				
Trichloroethylene	10.8		"	10.0		108	82-128				
Trichlorofluoromethane	10.2		"	10.0		102	67-139				
Vinyl Chloride	10.3		"	10.0		103	58-145				
Surrogate: SURRE: 1,2-Dichloroethane-d4	9.11		"	10.0		91.1	69-130				
Surrogate: SURRE: Toluene-d8	9.18		"	10.0		91.8	81-117				
Surrogate: SURRE: p-Bromofluorobenzene	10.2		"	10.0		102	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BE00379 - EPA 5030B											
LCS Dup (BE00379-BSD1)											
Prepared & Analyzed: 05/11/2020											
1,1,1,2-Tetrachloroethane	10.0		ug/L	10.0		100	82-126		4.39	30	
1,1,1-Trichloroethane	12.2		"	10.0		122	78-136		4.01	30	
1,1,2,2-Tetrachloroethane	9.39		"	10.0		93.9	76-129		3.45	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	14.4		"	10.0		144	54-165		1.25	30	
1,1,2-Trichloroethane	10.0		"	10.0		100	82-123		2.84	30	
1,1-Dichloroethane	11.0		"	10.0		110	82-129		1.79	30	
1,1-Dichloroethylene	12.4		"	10.0		124	68-138		1.36	30	
1,1-Dichloropropylene	11.6		"	10.0		116	83-133		2.30	30	
1,2,3-Trichlorobenzene	10.1		"	10.0		101	76-136		1.48	30	
1,2,3-Trichloropropane	9.99		"	10.0		99.9	77-128		2.47	30	
1,2,4-Trichlorobenzene	10.2		"	10.0		102	76-137		1.58	30	
1,2,4-Trimethylbenzene	9.91		"	10.0		99.1	82-132		3.47	30	
1,2-Dibromo-3-chloropropane	9.81		"	10.0		98.1	45-147		1.96	30	
1,2-Dibromoethane	10.7		"	10.0		107	83-124		0.835	30	
1,2-Dichlorobenzene	9.67		"	10.0		96.7	79-123		3.16	30	
1,2-Dichloroethane	10.8		"	10.0		108	73-132		1.57	30	
1,2-Dichloropropane	9.47		"	10.0		94.7	78-126		2.71	30	
1,3,5-Trimethylbenzene	10.1		"	10.0		101	80-131		5.03	30	
1,3-Dichlorobenzene	9.69		"	10.0		96.9	86-122		3.45	30	
1,3-Dichloropropane	9.83		"	10.0		98.3	81-125		1.61	30	
1,4-Dichlorobenzene	9.40		"	10.0		94.0	85-124		4.68	30	
2,2-Dichloropropane	12.1		"	10.0		121	56-150		4.22	30	
2-Chlorotoluene	9.45		"	10.0		94.5	79-130		4.15	30	
2-Hexanone	9.60		"	10.0		96.0	51-146		0.623	30	
4-Chlorotoluene	9.54		"	10.0		95.4	79-128		2.99	30	
Acetone	9.66		"	10.0		96.6	14-150		2.15	30	
Benzene	12.1		"	10.0		121	85-126		0.329	30	
Bromobenzene	9.38		"	10.0		93.8	78-129		2.63	30	
Bromochloromethane	11.1		"	10.0		111	77-128		0.00	30	
Bromodichloromethane	9.96		"	10.0		99.6	79-128		2.48	30	
Bromoform	10.1		"	10.0		101	78-133		0.498	30	
Bromomethane	10.6		"	10.0		106	43-168		1.24	30	
Carbon tetrachloride	11.9		"	10.0		119	77-141		3.06	30	
Chlorobenzene	10.1		"	10.0		101	88-120		1.77	30	
Chloroethane	9.91		"	10.0		99.1	65-136		1.90	30	
Chloroform	11.7		"	10.0		117	82-128		0.426	30	
Chloromethane	11.1		"	10.0		111	43-155		0.180	30	
cis-1,2-Dichloroethylene	11.4		"	10.0		114	83-129		1.48	30	
cis-1,3-Dichloropropylene	10.1		"	10.0		101	80-131		2.65	30	
Dibromochloromethane	10.7		"	10.0		107	80-130		1.66	30	
Dibromomethane	10.0		"	10.0		100	72-134		1.78	30	
Dichlorodifluoromethane	14.9		"	10.0		149	44-144	High Bias	2.84	30	
Ethyl Benzene	9.99		"	10.0		99.9	80-131		3.06	30	
Hexachlorobutadiene	9.97		"	10.0		99.7	67-146		4.32	30	
Isopropylbenzene	9.79		"	10.0		97.9	76-140		3.91	30	
Methyl tert-butyl ether (MTBE)	12.1		"	10.0		121	76-135		0.329	30	
Methylene chloride	11.5		"	10.0		115	55-137		1.04	30	
Naphthalene	10.8		"	10.0		108	70-147		0.0930	30	
n-Butylbenzene	8.90		"	10.0		89.0	79-132		4.18	30	
n-Propylbenzene	9.49		"	10.0		94.9	78-133		5.13	30	



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BE00379 - EPA 5030B

LCS Dup (BE00379-BSD1)


Prepared & Analyzed: 05/11/2020

o-Xylene	9.82		ug/L	10.0		98.2	78-130		1.62	30	
p- & m- Xylenes	20.0		"	20.0		99.9	77-133		2.57	30	
p-Isopropyltoluene	10.2		"	10.0		102	81-136		3.36	30	
sec-Butylbenzene	10.5		"	10.0		105	79-137		4.30	30	
Styrene	10.2		"	10.0		102	67-132		1.66	30	
tert-Butylbenzene	9.89		"	10.0		98.9	77-138		2.99	30	
Tetrachloroethylene	8.98		"	10.0		89.8	82-131		2.31	30	
Toluene	10.2		"	10.0		102	80-127		2.32	30	
trans-1,2-Dichloroethylene	12.2		"	10.0		122	80-132		1.30	30	
trans-1,3-Dichloropropylene	9.58		"	10.0		95.8	78-131		2.58	30	
Trichloroethylene	10.4		"	10.0		104	82-128		4.16	30	
Trichlorofluoromethane	9.89		"	10.0		98.9	67-139		2.59	30	
Vinyl Chloride	9.87		"	10.0		98.7	58-145		4.55	30	
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.08</i>		<i>"</i>	<i>10.0</i>		<i>90.8</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.06</i>		<i>"</i>	<i>10.0</i>		<i>90.6</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>10.1</i>		<i>"</i>	<i>10.0</i>		<i>101</i>	<i>79-122</i>				



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
20E0221-01	WQ050720:1015 NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- CCV-E The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

- * Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
- ND NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- LOQ LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
- LOD LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
- MDL METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
- Reported to This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.





York Analytical Laboratories, Inc.
 120 Research Drive Stratford, CT 06615
 132-02 89th Ave Queens, NY 11418
 clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.
 20E0221

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone:	203-929-8555	Phone:		Phone:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:		Contact:				RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:		E-mail:		YOUR PO#: 31401451.000 Task 01.00		Standard (5-7 Day) <input checked="" type="checkbox"/>	

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.

Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp.
S - soil / solid	New York	<input checked="" type="checkbox"/> Summary Report	CT RCP	<input checked="" type="checkbox"/> Standard Excel EDD	Compared to the following Regulation(s): (please fill in)
GW - groundwater	New Jersey	<input checked="" type="checkbox"/> QA Report	CT RCP DQA/DUE	EQuIS (Standard)	
DW - drinking water	Connecticut	<input type="checkbox"/> NY ASP A Package	NJDEP Reduced Deliverables	NYSDEC EQuIS	
WW - wastewater	Pennsylvania	<input checked="" type="checkbox"/> NY ASP B Package	NJDEP SRP HazSite		
O - Oil ; Other	Other		NJDKQP	Other:	

Samples Collected by: (print your name above and sign below)
 Scott Philbrick

Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
WQ0507201015 NPI-1-2	GW	5-20 10:15	VOCs 8260 full list + freon 113	3 HCl/VOA
	↓			

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> HNO3 <input type="checkbox"/> H2SO4 <input type="checkbox"/> NaOH <input type="checkbox"/> ZnAc <input type="checkbox"/> Ascorbic Acid <input type="checkbox"/> Other: <u>COOL</u>	Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/>

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
<i>Scott Philbrick WSP</i>	5-8-20 11:25				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Temp. Received at Lab
				<i>7/1/2020 5/8/2020 11:25</i>	<i>4.7</i>