

TABLE 2

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Effluent Water Quality Results

Date Sampled ^{2/}	pH ^{1/}	TDS ^{4/} (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis-1,2-DCE (ug/l)	trans-1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethylbenzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	6.5 to 8.5	---	5	5	5	5	5	5	5	5	5	5	5	---	10	7	---	---
1-Aug-19	6.8	168	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	1.30	1.24
5-Sep-19	6.8	172	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.291	ND<0.278
3-Oct-19	6.5	165	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.612	ND<0.278
4-Nov-19	6.0	102	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	0.536	ND<0.278
5-Dec-19	6.8	129	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
7-Jan-20	6.8	175	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
4-Feb-20	7.0	122	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
2-Mar-20	7.0	137	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
2-Apr-20	7.0	161	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
7-May-20	7.0	299	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
2-Jun-20	6.8	174	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA
7-Jul-20	7.0	125	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	NA	NA

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected NA: Not Analyzed

C = CCV-E: The value reported is estimated. The value is estimated due to its behavior during continuing calibration verification.


Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

Notes:


- Based on the SPDES criteria from an NYSDEC letter dated on May 6, 2016, the allowable pH range for the Rowe Site is between 6.5 and 8.5. The effluent pH was 7.0 on July 21, 2020. Historic pH measurements from recovery wells indicate that natural background pH concentrations are less than 6.5.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- Starting in October 2016, FSP&T system samples are collected monthly instead of once every two weeks. The pH of the effluent water is measured two times per month in accordance with the SPDES requirements.

**GRAPH 1
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Effluent Flow Data
(July 1, 2020 to July 30, 2020)**

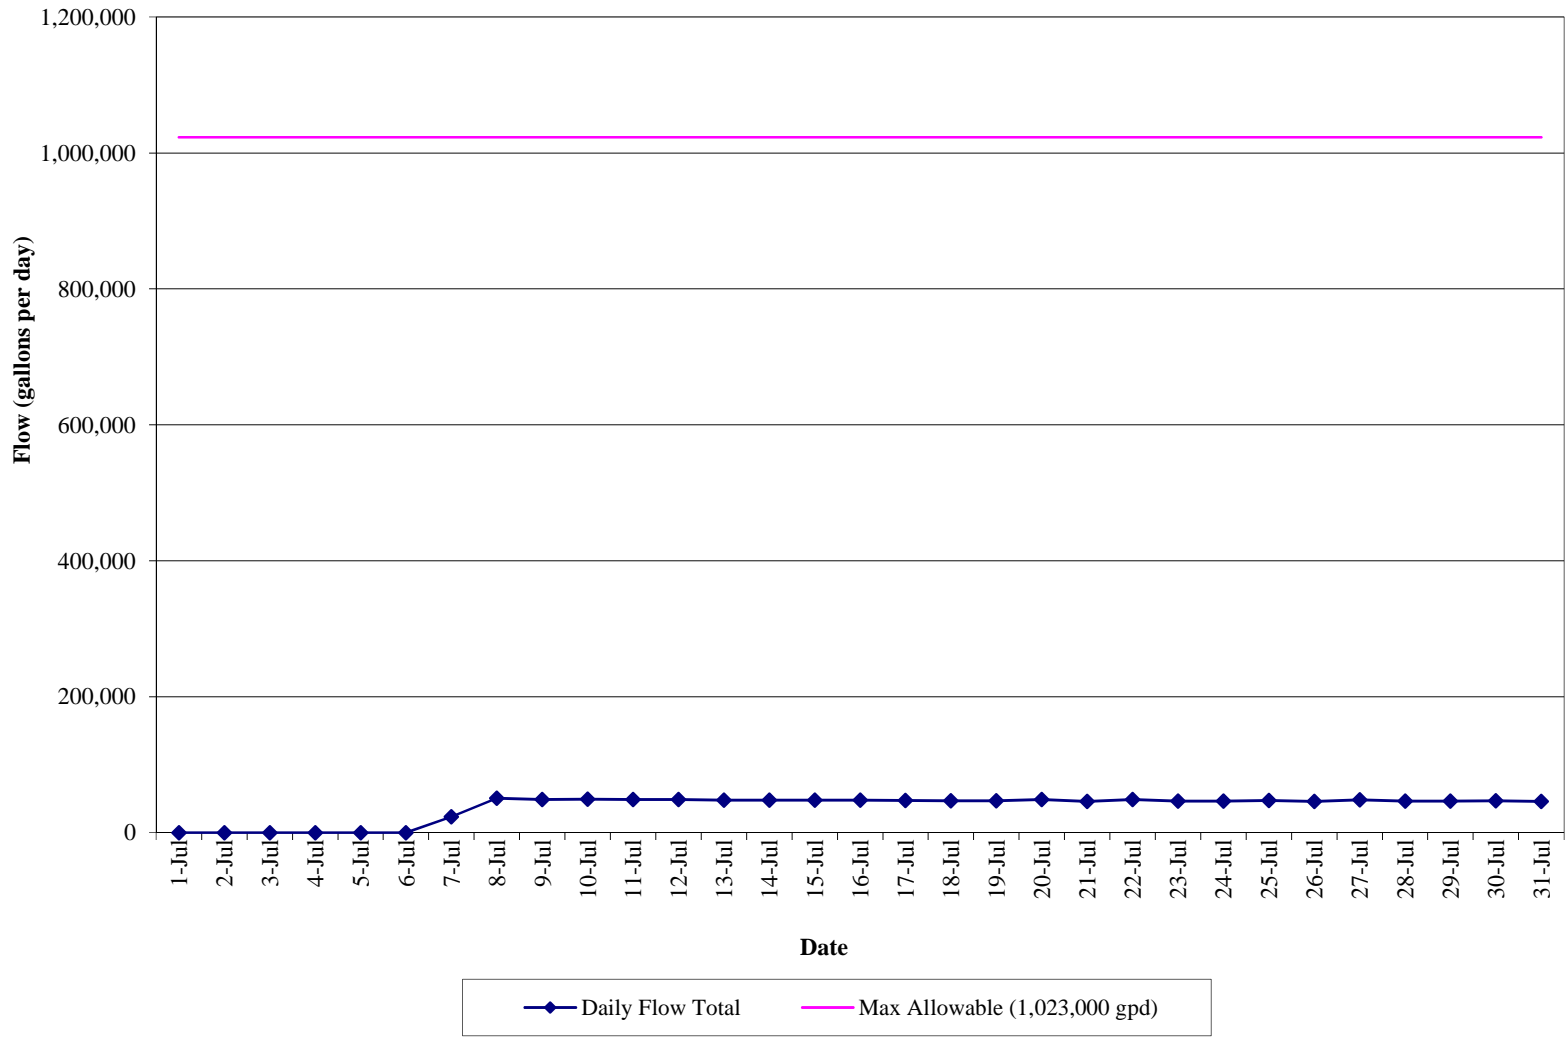

APPENDIX I
JULY 2020 LABORATORY ANALYTICAL REPORT
FOR FSP&T SYSTEM AND RW-2



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 07/14/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20G0227

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 07, 2020 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20G0227-01	WQ070720:1320 NP2-10	Water	07/07/2020	07/07/2020

General Notes for York Project (SDG) No.: 20G0227

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/14/2020





Sample Information

Client Sample ID: WQ070720:1320 NP2-10

York Sample ID: 20G0227-01

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
20G0227	31401451.000 Task 01.00 Rowe Industries	Water	July 7, 2020 1:20 pm	07/07/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	07/08/2020 00:46	07/10/2020 20:26	TMP
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP



Sample Information

Client Sample ID: WQ070720:1320 NP2-10

York Sample ID: 20G0227-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0227

31401451.000 Task 01.00 Rowe Industries

Water

July 7, 2020 1:20 pm

07/07/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP



Sample Information

Client Sample ID: WQ070720:1320 NP2-10

York Sample ID: 20G0227-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0227

31401451.000 Task 01.00 Rowe Industries

Water

July 7, 2020 1:20 pm

07/07/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:


Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:26	TMP
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	07/08/2020 00:46	07/10/2020 20:26	TMP
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	103 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	93.2 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	102 %	79-122								

Total Dissolved Solids

Log-in Notes:

Sample Notes:



Sample Information


Client Sample ID: WQ070720:1320 NP2-10

York Sample ID: 20G0227-01

<u>York Project (SDG) No.</u> 20G0227	<u>Client Project ID</u> 31401451.000 Task 01.00 Rowe Industries	<u>Matrix</u> Water	<u>Collection Date/Time</u> July 7, 2020 1:20 pm	<u>Date Received</u> 07/07/2020
--	---	------------------------	---	------------------------------------

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst	
	Total Dissolved Solids	125		mg/L	10.0	1	SM 2540C	07/08/2020 18:01	07/10/2020 17:04	AA	
							Certifications:	NELAC-NY10854,CTDOH,NJDEP,PADEP			



Analytical Batch Summary

Batch ID: BG00374

Preparation Method: EPA 5030B

Prepared By: TMP

YORK Sample ID	Client Sample ID	Preparation Date
20G0227-01	WQ070720:1320 NP2-10	07/08/20
BG00374-BLK1	Blank	07/10/20
BG00374-BS1	LCS	07/10/20
BG00374-BSD1	LCS Dup	07/10/20

Batch ID: BG00411

Preparation Method: % Solids Prep

Prepared By: AA

YORK Sample ID	Client Sample ID	Preparation Date
20G0227-01	WQ070720:1320 NP2-10	07/08/20
BG00411-BLK1	Blank	07/08/20



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG00374 - EPA 5030B

Blank (BG00374-BLK1)

Prepared & Analyzed: 07/10/2020

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG00374 - EPA 5030B

Blank (BG00374-BLK1)

Prepared & Analyzed: 07/10/2020

n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<hr/>											
Surrogate: SURR: 1,2-Dichloroethane-d4	10.1		"	10.0		101	69-130				
Surrogate: SURR: Toluene-d8	9.34		"	10.0		93.4	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.3		"	10.0		103	79-122				

LCS (BG00374-BS1)

Prepared & Analyzed: 07/10/2020

1,1,1,2-Tetrachloroethane	8.50		ug/L	10.0		85.0	82-126				
1,1,1-Trichloroethane	9.64		"	10.0		96.4	78-136				
1,1,2,2-Tetrachloroethane	7.76		"	10.0		77.6	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.1		"	10.0		101	54-165				
1,1,2-Trichloroethane	7.85		"	10.0		78.5	82-123	Low Bias			
1,1-Dichloroethane	9.51		"	10.0		95.1	82-129				
1,1-Dichloroethylene	10.2		"	10.0		102	68-138				
1,1-Dichloropropylene	9.24		"	10.0		92.4	83-133				
1,2,3-Trichlorobenzene	5.12		"	10.0		51.2	76-136	Low Bias			
1,2,3-Trichloropropane	8.34		"	10.0		83.4	77-128				
1,2,4-Trichlorobenzene	6.59		"	10.0		65.9	76-137	Low Bias			
1,2,4-Trimethylbenzene	9.00		"	10.0		90.0	82-132				
1,2-Dibromo-3-chloropropane	7.15		"	10.0		71.5	45-147				
1,2-Dibromoethane	8.02		"	10.0		80.2	83-124	Low Bias			
1,2-Dichlorobenzene	8.77		"	10.0		87.7	79-123				
1,2-Dichloroethane	9.51		"	10.0		95.1	73-132				
1,2-Dichloropropane	7.74		"	10.0		77.4	78-126	Low Bias			
1,3,5-Trimethylbenzene	8.88		"	10.0		88.8	80-131				
1,3-Dichlorobenzene	8.91		"	10.0		89.1	86-122				
1,3-Dichloropropane	7.77		"	10.0		77.7	81-125	Low Bias			
1,4-Dichlorobenzene	9.08		"	10.0		90.8	85-124				
2,2-Dichloropropane	14.1		"	10.0		141	56-150				
2-Chlorotoluene	8.76		"	10.0		87.6	79-130				
2-Hexanone	6.84		"	10.0		68.4	51-146				
4-Chlorotoluene	8.82		"	10.0		88.2	79-128				
Acetone	8.84		"	10.0		88.4	14-150				
Benzene	9.19		"	10.0		91.9	85-126				
Bromobenzene	7.92		"	10.0		79.2	78-129				
Bromochloromethane	9.49		"	10.0		94.9	77-128				
Bromodichloromethane	7.95		"	10.0		79.5	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit			Result					Limit			

Batch BG00374 - EPA 5030B

LCS (BG00374-BS1)

Prepared & Analyzed: 07/10/2020

Bromoform	7.14		ug/L	10.0		71.4	78-133		Low Bias				
Bromomethane	3.67		"	10.0		36.7	43-168		Low Bias				
Carbon tetrachloride	8.90		"	10.0		89.0	77-141						
Chlorobenzene	8.65		"	10.0		86.5	88-120		Low Bias				
Chloroethane	10.9		"	10.0		109	65-136						
Chloroform	9.52		"	10.0		95.2	82-128						
Chloromethane	13.8		"	10.0		138	43-155						
cis-1,2-Dichloroethylene	10.0		"	10.0		100	83-129						
cis-1,3-Dichloropropylene	7.86		"	10.0		78.6	80-131		Low Bias				
Dibromochloromethane	7.82		"	10.0		78.2	80-130		Low Bias				
Dibromomethane	7.93		"	10.0		79.3	72-134						
Dichlorodifluoromethane	14.2		"	10.0		142	44-144						
Ethyl Benzene	8.59		"	10.0		85.9	80-131						
Hexachlorobutadiene	7.81		"	10.0		78.1	67-146						
Isopropylbenzene	8.25		"	10.0		82.5	76-140						
Methyl tert-butyl ether (MTBE)	8.73		"	10.0		87.3	76-135						
Methylene chloride	9.52		"	10.0		95.2	55-137						
Naphthalene	5.14		"	10.0		51.4	70-147		Low Bias				
n-Butylbenzene	8.02		"	10.0		80.2	79-132						
n-Propylbenzene	8.08		"	10.0		80.8	78-133						
o-Xylene	8.66		"	10.0		86.6	78-130						
p- & m- Xylenes	17.2		"	20.0		85.8	77-133						
p-Isopropyltoluene	8.42		"	10.0		84.2	81-136						
sec-Butylbenzene	8.12		"	10.0		81.2	79-137						
Styrene	8.82		"	10.0		88.2	67-132						
tert-Butylbenzene	6.70		"	10.0		67.0	77-138		Low Bias				
Tetrachloroethylene	8.60		"	10.0		86.0	82-131						
Toluene	8.32		"	10.0		83.2	80-127						
trans-1,2-Dichloroethylene	10.0		"	10.0		100	80-132						
trans-1,3-Dichloropropylene	7.53		"	10.0		75.3	78-131		Low Bias				
Trichloroethylene	8.29		"	10.0		82.9	82-128						
Trichlorofluoromethane	12.0		"	10.0		120	67-139						
Vinyl Chloride	12.5		"	10.0		125	58-145						
Surrogate: SURR: 1,2-Dichloroethane-d4	10.3		"	10.0		103	69-130						
Surrogate: SURR: Toluene-d8	9.38		"	10.0		93.8	81-117						
Surrogate: SURR: p-Bromofluorobenzene	10.2		"	10.0		102	79-122						



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG00374 - EPA 5030B											
LCS Dup (BG00374-BSD1)											
Prepared & Analyzed: 07/10/2020											
1,1,1,2-Tetrachloroethane	9.05		ug/L	10.0		90.5	82-126		6.27	30	
1,1,1-Trichloroethane	10.4		"	10.0		104	78-136		7.87	30	
1,1,2,2-Tetrachloroethane	8.58		"	10.0		85.8	76-129		10.0	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.2		"	10.0		112	54-165		10.5	30	
1,1,2-Trichloroethane	8.75		"	10.0		87.5	82-123		10.8	30	
1,1-Dichloroethane	9.96		"	10.0		99.6	82-129		4.62	30	
1,1-Dichloroethylene	11.2		"	10.0		112	68-138		9.57	30	
1,1-Dichloropropylene	10.1		"	10.0		101	83-133		9.19	30	
1,2,3-Trichlorobenzene	5.64		"	10.0		56.4	76-136	Low Bias	9.67	30	
1,2,3-Trichloropropane	9.41		"	10.0		94.1	77-128		12.1	30	
1,2,4-Trichlorobenzene	7.38		"	10.0		73.8	76-137	Low Bias	11.3	30	
1,2,4-Trimethylbenzene	9.64		"	10.0		96.4	82-132		6.87	30	
1,2-Dibromo-3-chloropropane	7.84		"	10.0		78.4	45-147		9.21	30	
1,2-Dibromoethane	8.90		"	10.0		89.0	83-124		10.4	30	
1,2-Dichlorobenzene	9.57		"	10.0		95.7	79-123		8.72	30	
1,2-Dichloroethane	10.3		"	10.0		103	73-132		8.36	30	
1,2-Dichloropropane	8.42		"	10.0		84.2	78-126		8.42	30	
1,3,5-Trimethylbenzene	9.51		"	10.0		95.1	80-131		6.85	30	
1,3-Dichlorobenzene	9.54		"	10.0		95.4	86-122		6.83	30	
1,3-Dichloropropane	8.60		"	10.0		86.0	81-125		10.1	30	
1,4-Dichlorobenzene	9.80		"	10.0		98.0	85-124		7.63	30	
2,2-Dichloropropane	14.8		"	10.0		148	56-150		4.57	30	
2-Chlorotoluene	9.45		"	10.0		94.5	79-130		7.58	30	
2-Hexanone	7.60		"	10.0		76.0	51-146		10.5	30	
4-Chlorotoluene	9.39		"	10.0		93.9	79-128		6.26	30	
Acetone	9.49		"	10.0		94.9	14-150		7.09	30	
Benzene	9.91		"	10.0		99.1	85-126		7.54	30	
Bromobenzene	9.05		"	10.0		90.5	78-129		13.3	30	
Bromochloromethane	10.3		"	10.0		103	77-128		8.28	30	
Bromodichloromethane	8.61		"	10.0		86.1	79-128		7.97	30	
Bromoform	7.89		"	10.0		78.9	78-133		9.98	30	
Bromomethane	3.45		"	10.0		34.5	43-168	Low Bias	6.18	30	
Carbon tetrachloride	9.74		"	10.0		97.4	77-141		9.01	30	
Chlorobenzene	9.39		"	10.0		93.9	88-120		8.20	30	
Chloroethane	11.7		"	10.0		117	65-136		6.64	30	
Chloroform	10.3		"	10.0		103	82-128		7.68	30	
Chloromethane	12.3		"	10.0		123	43-155		11.1	30	
cis-1,2-Dichloroethylene	10.6		"	10.0		106	83-129		5.24	30	
cis-1,3-Dichloropropylene	8.40		"	10.0		84.0	80-131		6.64	30	
Dibromochloromethane	8.54		"	10.0		85.4	80-130		8.80	30	
Dibromomethane	8.59		"	10.0		85.9	72-134		7.99	30	
Dichlorodifluoromethane	18.5		"	10.0		185	44-144	High Bias	26.3	30	
Ethyl Benzene	9.27		"	10.0		92.7	80-131		7.61	30	
Hexachlorobutadiene	7.96		"	10.0		79.6	67-146		1.90	30	
Isopropylbenzene	8.96		"	10.0		89.6	76-140		8.25	30	
Methyl tert-butyl ether (MTBE)	9.50		"	10.0		95.0	76-135		8.45	30	
Methylene chloride	10.2		"	10.0		102	55-137		7.09	30	
Naphthalene	5.84		"	10.0		58.4	70-147	Low Bias	12.8	30	
n-Butylbenzene	8.62		"	10.0		86.2	79-132		7.21	30	
n-Propylbenzene	8.88		"	10.0		88.8	78-133		9.43	30	



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG00374 - EPA 5030B

LCS Dup (BG00374-BSD1)

Prepared & Analyzed: 07/10/2020

o-Xylene	9.37		ug/L	10.0		93.7	78-130		7.88	30	
p- & m- Xylenes	18.7		"	20.0		93.6	77-133		8.70	30	
p-Isopropyltoluene	9.19		"	10.0		91.9	81-136		8.75	30	
sec-Butylbenzene	8.98		"	10.0		89.8	79-137		10.1	30	
Styrene	9.55		"	10.0		95.5	67-132		7.95	30	
tert-Butylbenzene	7.38		"	10.0		73.8	77-138	Low Bias	9.66	30	
Tetrachloroethylene	9.41		"	10.0		94.1	82-131		8.99	30	
Toluene	8.97		"	10.0		89.7	80-127		7.52	30	
trans-1,2-Dichloroethylene	10.7		"	10.0		107	80-132		6.64	30	
trans-1,3-Dichloropropylene	8.15		"	10.0		81.5	78-131		7.91	30	
Trichloroethylene	8.96		"	10.0		89.6	82-128		7.77	30	
Trichlorofluoromethane	12.0		"	10.0		120	67-139		0.418	30	
Vinyl Chloride	12.5		"	10.0		125	58-145		0.160	30	
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>10.5</i>		<i>"</i>	<i>10.0</i>		<i>105</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>9.34</i>		<i>"</i>	<i>10.0</i>		<i>93.4</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>79-122</i>				



Miscellaneous Physical Parameters - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG00411 - % Solids Prep

Blank (BG00411-BLK1)


Prepared: 07/08/2020 Analyzed: 07/10/2020

Total Dissolved Solids	ND	10.0	mg/L								
------------------------	----	------	------	--	--	--	--	--	--	--	--



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
20G0227-01	WQ070720:1320 NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- CCV-E The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

- * Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
- ND NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- LOQ LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
- LOD LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
- MDL METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
- Reported to This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.
 120 Research Drive Stratford, CT 06615
 132-02 89th Ave Queens, NY 11418
 clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.
 2060227

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

Page 1 of 1


YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone.:	203-929-8555	Phone.:		Phone.:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:		Contact:		YOUR PO#: 31401451.000 Task 01.00		RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:		E-mail:				Standard (5-7 Day)	X

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.	Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp. Compared to the following Regulation(s): (please fill in)	
	S - soil / solid	New York	<input checked="" type="checkbox"/>	Summary Report	CT RCP		Standard Excel EDD
	GW - groundwater	New Jersey		QA Report	CT RCP DQA/DUE		EQulS (Standard)
	DW - drinking water	Connecticut		NY ASP A Package	NJDEP Reduced Deliverables		NYSDEC EQulS
	WW - wastewater	Pennsylvania		NY ASP B Package	NJDEP SRP HazSite		
O - Oil ; Other	Other			NJDQOP	Other:		
Samples Collected by: (print your name above and sign below)							

Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
WQ 070720-1310 NP2-6	GW	7-7-20 13:20	VOCs 8260 full list + freon 113	3 HCl VOA
WQ 070720-1320 NP2-1D	GW	7-7-20 13:20	VOCs 8260 full list + freon 113: TDS	3 HCl VOA; 1 plastic

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH ___ HNO ₃ ___ H ₂ SO ₄ ___ NaOH ___ ZnAc ___ Ascorbic Acid ___ Other: <u>EDD</u>	Field Filtered ___ Lab to Filter ___

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
<i>[Signature]</i> WSP	7-7-20 10:30				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Temp. Received at Lab
				<i>[Signature]</i> 7/17/20 10:16	4.5 Degrees C



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 07/14/2020
Client Project ID: 31401451.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20G0224

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 07, 2020 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20G0224-01	WQ070720:1245 NP1-1-2	Water	07/07/2020	07/07/2020

General Notes for York Project (SDG) No.: 20G0224

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/14/2020





Sample Information

Client Sample ID: WQ070720:1245 NP1-1-2

York Sample ID: 20G0224-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0224

31401451.000 Task 01.00 Rowe Industries

Water

July 7, 2020 12:45 pm

07/07/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	07/08/2020 00:46	07/10/2020 20:01	TMP
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP



Sample Information

Client Sample ID: WQ070720:1245 NP1-1-2

York Sample ID: 20G0224-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0224

31401451.000 Task 01.00 Rowe Industries

Water

July 7, 2020 12:45 pm

07/07/2020

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
67-64-1	Acetone	1.15		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
74-87-3	Chloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP



Sample Information

Client Sample ID: WQ070720:1245 NP1-1-2

York Sample ID: 20G0224-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0224

31401451.000 Task 01.00 Rowe Industries

Water

July 7, 2020 12:45 pm

07/07/2020


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
127-18-4	Tetrachloroethylene	0.220		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	07/08/2020 00:46	07/10/2020 20:01	TMP
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	07/08/2020 00:46	07/10/2020 20:01	TMP
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	102 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	93.4 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	100 %	79-122								



Analytical Batch Summary

Batch ID: BG00374

Preparation Method: EPA 5030B

Prepared By: TMP

YORK Sample ID	Client Sample ID	Preparation Date
20G0224-01	WQ070720:1245 NP1-1-2	07/08/20
BG00374-BLK1	Blank	07/10/20
BG00374-BS1	LCS	07/10/20
BG00374-BSD1	LCS Dup	07/10/20



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG00374 - EPA 5030B

Blank (BG00374-BLK1)

Prepared & Analyzed: 07/10/2020

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	
Batch BG00374 - EPA 5030B											
Blank (BG00374-BLK1)										Prepared & Analyzed: 07/10/2020	
n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<hr/>											
Surrogate: SURR: 1,2-Dichloroethane-d4	10.1		"	10.0		101	69-130				
Surrogate: SURR: Toluene-d8	9.34		"	10.0		93.4	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.3		"	10.0		103	79-122				
<hr/>											
LCS (BG00374-BS1)										Prepared & Analyzed: 07/10/2020	
1,1,1,2-Tetrachloroethane	8.50		ug/L	10.0		85.0	82-126				
1,1,1-Trichloroethane	9.64		"	10.0		96.4	78-136				
1,1,2,2-Tetrachloroethane	7.76		"	10.0		77.6	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.1		"	10.0		101	54-165				
1,1,2-Trichloroethane	7.85		"	10.0		78.5	82-123	Low Bias			
1,1-Dichloroethane	9.51		"	10.0		95.1	82-129				
1,1-Dichloroethylene	10.2		"	10.0		102	68-138				
1,1-Dichloropropylene	9.24		"	10.0		92.4	83-133				
1,2,3-Trichlorobenzene	5.12		"	10.0		51.2	76-136	Low Bias			
1,2,3-Trichloropropane	8.34		"	10.0		83.4	77-128				
1,2,4-Trichlorobenzene	6.59		"	10.0		65.9	76-137	Low Bias			
1,2,4-Trimethylbenzene	9.00		"	10.0		90.0	82-132				
1,2-Dibromo-3-chloropropane	7.15		"	10.0		71.5	45-147				
1,2-Dibromoethane	8.02		"	10.0		80.2	83-124	Low Bias			
1,2-Dichlorobenzene	8.77		"	10.0		87.7	79-123				
1,2-Dichloroethane	9.51		"	10.0		95.1	73-132				
1,2-Dichloropropane	7.74		"	10.0		77.4	78-126	Low Bias			
1,3,5-Trimethylbenzene	8.88		"	10.0		88.8	80-131				
1,3-Dichlorobenzene	8.91		"	10.0		89.1	86-122				
1,3-Dichloropropane	7.77		"	10.0		77.7	81-125	Low Bias			
1,4-Dichlorobenzene	9.08		"	10.0		90.8	85-124				
2,2-Dichloropropane	14.1		"	10.0		141	56-150				
2-Chlorotoluene	8.76		"	10.0		87.6	79-130				
2-Hexanone	6.84		"	10.0		68.4	51-146				
4-Chlorotoluene	8.82		"	10.0		88.2	79-128				
Acetone	8.84		"	10.0		88.4	14-150				
Benzene	9.19		"	10.0		91.9	85-126				
Bromobenzene	7.92		"	10.0		79.2	78-129				
Bromochloromethane	9.49		"	10.0		94.9	77-128				
Bromodichloromethane	7.95		"	10.0		79.5	79-128				



Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG00374 - EPA 5030B

LCS (BG00374-BS1)

Prepared & Analyzed: 07/10/2020

Bromoform	7.14		ug/L	10.0		71.4	78-133	Low Bias			
Bromomethane	3.67		"	10.0		36.7	43-168	Low Bias			
Carbon tetrachloride	8.90		"	10.0		89.0	77-141				
Chlorobenzene	8.65		"	10.0		86.5	88-120	Low Bias			
Chloroethane	10.9		"	10.0		109	65-136				
Chloroform	9.52		"	10.0		95.2	82-128				
Chloromethane	13.8		"	10.0		138	43-155				
cis-1,2-Dichloroethylene	10.0		"	10.0		100	83-129				
cis-1,3-Dichloropropylene	7.86		"	10.0		78.6	80-131	Low Bias			
Dibromochloromethane	7.82		"	10.0		78.2	80-130	Low Bias			
Dibromomethane	7.93		"	10.0		79.3	72-134				
Dichlorodifluoromethane	14.2		"	10.0		142	44-144				
Ethyl Benzene	8.59		"	10.0		85.9	80-131				
Hexachlorobutadiene	7.81		"	10.0		78.1	67-146				
Isopropylbenzene	8.25		"	10.0		82.5	76-140				
Methyl tert-butyl ether (MTBE)	8.73		"	10.0		87.3	76-135				
Methylene chloride	9.52		"	10.0		95.2	55-137				
Naphthalene	5.14		"	10.0		51.4	70-147	Low Bias			
n-Butylbenzene	8.02		"	10.0		80.2	79-132				
n-Propylbenzene	8.08		"	10.0		80.8	78-133				
o-Xylene	8.66		"	10.0		86.6	78-130				
p- & m- Xylenes	17.2		"	20.0		85.8	77-133				
p-Isopropyltoluene	8.42		"	10.0		84.2	81-136				
sec-Butylbenzene	8.12		"	10.0		81.2	79-137				
Styrene	8.82		"	10.0		88.2	67-132				
tert-Butylbenzene	6.70		"	10.0		67.0	77-138	Low Bias			
Tetrachloroethylene	8.60		"	10.0		86.0	82-131				
Toluene	8.32		"	10.0		83.2	80-127				
trans-1,2-Dichloroethylene	10.0		"	10.0		100	80-132				
trans-1,3-Dichloropropylene	7.53		"	10.0		75.3	78-131	Low Bias			
Trichloroethylene	8.29		"	10.0		82.9	82-128				
Trichlorofluoromethane	12.0		"	10.0		120	67-139				
Vinyl Chloride	12.5		"	10.0		125	58-145				
Surrogate: SURRE: 1,2-Dichloroethane-d4	10.3		"	10.0		103	69-130				
Surrogate: SURRE: Toluene-d8	9.38		"	10.0		93.8	81-117				
Surrogate: SURRE: p-Bromofluorobenzene	10.2		"	10.0		102	79-122				



Volatile Organic Compounds by GC/MS - Quality Control Data


York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG00374 - EPA 5030B											
LCS Dup (BG00374-BSD1)											
Prepared & Analyzed: 07/10/2020											
1,1,1,2-Tetrachloroethane	9.05		ug/L	10.0		90.5	82-126		6.27	30	
1,1,1-Trichloroethane	10.4		"	10.0		104	78-136		7.87	30	
1,1,2,2-Tetrachloroethane	8.58		"	10.0		85.8	76-129		10.0	30	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.2		"	10.0		112	54-165		10.5	30	
1,1,2-Trichloroethane	8.75		"	10.0		87.5	82-123		10.8	30	
1,1-Dichloroethane	9.96		"	10.0		99.6	82-129		4.62	30	
1,1-Dichloroethylene	11.2		"	10.0		112	68-138		9.57	30	
1,1-Dichloropropylene	10.1		"	10.0		101	83-133		9.19	30	
1,2,3-Trichlorobenzene	5.64		"	10.0		56.4	76-136	Low Bias	9.67	30	
1,2,3-Trichloropropane	9.41		"	10.0		94.1	77-128		12.1	30	
1,2,4-Trichlorobenzene	7.38		"	10.0		73.8	76-137	Low Bias	11.3	30	
1,2,4-Trimethylbenzene	9.64		"	10.0		96.4	82-132		6.87	30	
1,2-Dibromo-3-chloropropane	7.84		"	10.0		78.4	45-147		9.21	30	
1,2-Dibromoethane	8.90		"	10.0		89.0	83-124		10.4	30	
1,2-Dichlorobenzene	9.57		"	10.0		95.7	79-123		8.72	30	
1,2-Dichloroethane	10.3		"	10.0		103	73-132		8.36	30	
1,2-Dichloropropane	8.42		"	10.0		84.2	78-126		8.42	30	
1,3,5-Trimethylbenzene	9.51		"	10.0		95.1	80-131		6.85	30	
1,3-Dichlorobenzene	9.54		"	10.0		95.4	86-122		6.83	30	
1,3-Dichloropropane	8.60		"	10.0		86.0	81-125		10.1	30	
1,4-Dichlorobenzene	9.80		"	10.0		98.0	85-124		7.63	30	
2,2-Dichloropropane	14.8		"	10.0		148	56-150		4.57	30	
2-Chlorotoluene	9.45		"	10.0		94.5	79-130		7.58	30	
2-Hexanone	7.60		"	10.0		76.0	51-146		10.5	30	
4-Chlorotoluene	9.39		"	10.0		93.9	79-128		6.26	30	
Acetone	9.49		"	10.0		94.9	14-150		7.09	30	
Benzene	9.91		"	10.0		99.1	85-126		7.54	30	
Bromobenzene	9.05		"	10.0		90.5	78-129		13.3	30	
Bromochloromethane	10.3		"	10.0		103	77-128		8.28	30	
Bromodichloromethane	8.61		"	10.0		86.1	79-128		7.97	30	
Bromoform	7.89		"	10.0		78.9	78-133		9.98	30	
Bromomethane	3.45		"	10.0		34.5	43-168	Low Bias	6.18	30	
Carbon tetrachloride	9.74		"	10.0		97.4	77-141		9.01	30	
Chlorobenzene	9.39		"	10.0		93.9	88-120		8.20	30	
Chloroethane	11.7		"	10.0		117	65-136		6.64	30	
Chloroform	10.3		"	10.0		103	82-128		7.68	30	
Chloromethane	12.3		"	10.0		123	43-155		11.1	30	
cis-1,2-Dichloroethylene	10.6		"	10.0		106	83-129		5.24	30	
cis-1,3-Dichloropropylene	8.40		"	10.0		84.0	80-131		6.64	30	
Dibromochloromethane	8.54		"	10.0		85.4	80-130		8.80	30	
Dibromomethane	8.59		"	10.0		85.9	72-134		7.99	30	
Dichlorodifluoromethane	18.5		"	10.0		185	44-144	High Bias	26.3	30	
Ethyl Benzene	9.27		"	10.0		92.7	80-131		7.61	30	
Hexachlorobutadiene	7.96		"	10.0		79.6	67-146		1.90	30	
Isopropylbenzene	8.96		"	10.0		89.6	76-140		8.25	30	
Methyl tert-butyl ether (MTBE)	9.50		"	10.0		95.0	76-135		8.45	30	
Methylene chloride	10.2		"	10.0		102	55-137		7.09	30	
Naphthalene	5.84		"	10.0		58.4	70-147	Low Bias	12.8	30	
n-Butylbenzene	8.62		"	10.0		86.2	79-132		7.21	30	
n-Propylbenzene	8.88		"	10.0		88.8	78-133		9.43	30	




Volatile Organic Compounds by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG00374 - EPA 5030B											
LCS Dup (BG00374-BSD1)											
Prepared & Analyzed: 07/10/2020											
o-Xylene	9.37		ug/L	10.0		93.7	78-130		7.88	30	
p- & m- Xylenes	18.7		"	20.0		93.6	77-133		8.70	30	
p-Isopropyltoluene	9.19		"	10.0		91.9	81-136		8.75	30	
sec-Butylbenzene	8.98		"	10.0		89.8	79-137		10.1	30	
Styrene	9.55		"	10.0		95.5	67-132		7.95	30	
tert-Butylbenzene	7.38		"	10.0		73.8	77-138	Low Bias	9.66	30	
Tetrachloroethylene	9.41		"	10.0		94.1	82-131		8.99	30	
Toluene	8.97		"	10.0		89.7	80-127		7.52	30	
trans-1,2-Dichloroethylene	10.7		"	10.0		107	80-132		6.64	30	
trans-1,3-Dichloropropylene	8.15		"	10.0		81.5	78-131		7.91	30	
Trichloroethylene	8.96		"	10.0		89.6	82-128		7.77	30	
Trichlorofluoromethane	12.0		"	10.0		120	67-139		0.418	30	
Vinyl Chloride	12.5		"	10.0		125	58-145		0.160	30	
Surrogate: SURR: 1,2-Dichloroethane-d4	10.5		"	10.0		105	69-130				
Surrogate: SURR: Toluene-d8	9.34		"	10.0		93.4	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.0		"	10.0		100	79-122				



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
20G0224-01	WQ070720:1245 NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



Sample and Data Qualifiers Relating to This Work Order

- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- CCV-E The value reported is ESTIMATED. The value is estimated due to its behavior during continuing calibration verification (>20% Difference for average Rf or >20% Drift for quadratic fit).

Definitions and Other Explanations

- * Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
- ND NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- LOQ LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
- LOD LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
- MDL METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
- Reported to This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.


If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.



For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.
 120 Research Drive Stratford, CT 06615
 132-02 89th Ave Queens, NY 11418
 clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record

YORK Project No.
 2060224

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company: WSP USA		Company: Same		Company: WSP USA Accounting		31401451.000 Task 01.00		RUSH - Next Day	
Address: 4 Research Drive, Suite 204 Shelton, CT 06484		Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone.: 203-929-8555		Phone.:		Phone.:				RUSH - Three Day	
Contact: Tunde Komuves-Sandor		Contact:		Contact:		YOUR PO#: 31401451.000 Task 01.00		RUSH - Four Day	
E-mail: tunde.sandor@wsp.com		E-mail: ↓		E-mail:				Standard (5-7 Day)	

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.


Samples Collected by: (print your name above and sign below)	Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp. Compared to the following Regulation(s): (please fill in)	
	S - soil / solid	New York	<input checked="" type="checkbox"/>	Summary Report	CT RCP		Standard Excel EDD
	GW - groundwater	New Jersey		QA Report	CT RCP DQA/DUE		EQuIS (Standard)
	DW - drinking water	Connecticut		NY ASP A Package	NJDEP Reduced Deliverables		NYSDEC EQuIS
	WW - wastewater	Pennsylvania		NY ASP B Package	NJDEP SRP HazSite		
	O - Oil ; Other	Other			NJDQKP	Other:	

Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
LDQ070720:1245 NPI-1-2	GW	7-7-20 12:45	VOCs 8260 full list + freon 113	3 HCl VOA
	↓			

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH ___ HNO3 ___ H2SO4 ___ NaOH ___ ZnAc ___ Ascorbic Acid ___ Other: <u>Cool</u>	Field Filtered ___ Lab to Filter ___

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
<i>[Signature]</i> WSP	7-7-20 16:16				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Date/Time
				<i>[Signature]</i>	7/7/20 16:16
					Temp. Received at Lab
					4.5 Degrees C

APPENDIX II
JULY 2020 LABORATORY ANALYTICAL REPORT
FOR AIR SAMPLES



Technical Report

prepared for:

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Report Date: 07/29/2020
Client Project ID: 31402600.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20G0775

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE
www.YORKLAB.com

STRATFORD, CT 06615
(203) 325-1371

132-02 89th AVENUE
FAX (203) 357-0166

RICHMOND HILL, NY 11418
ClientServices@yorklab.com

Report Date: 07/29/2020
Client Project ID: 31402600.000 Task 01.00 Rowe Industries
York Project (SDG) No.: 20G0775

WSP USA, Inc. (Shelton)
4 Research Drive, Suite 204
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 22, 2020 and listed below. The project was identified as your project: **31402600.000 Task 01.00 Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
20G0775-01	AQ072120:930NP4-1	Vapor Extraction	07/21/2020	07/22/2020
20G0775-02	AQ072120:935NP4-3	Vapor Extraction	07/21/2020	07/22/2020

General Notes for York Project (SDG) No.: 20G0775

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/29/2020





Sample Information

Client Sample ID: AQ072120:930NP4-1

York Sample ID: 20G0775-01

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
20G0775	31402600.000 Task 01.00 Rowe Industries	Vapor Extraction	July 21, 2020 9:30 am	07/22/2020

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	0.96	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.76	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	0.96	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	1.1	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.76	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.57	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.14	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	1.0	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
95-63-6	1,2,4-Trimethylbenzene	1.4		ug/m ³	0.69	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
106-93-4	1,2-Dibromoethane	ND		ug/m ³	1.1	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.84	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.56	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.65	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	0.98	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.69	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
106-99-0	1,3-Butadiene	ND		ug/m ³	0.93	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.84	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.65	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.84	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
123-91-1	1,4-Dioxane	ND		ug/m ³	1.0	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
78-93-3	2-Butanone	3.2		ug/m ³	0.41	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
591-78-6	* 2-Hexanone	ND		ug/m ³	1.1	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ



Sample Information

Client Sample ID: AQ072120:930NP4-1

York Sample ID: 20G0775-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0775

31402600.000 Task 01.00 Rowe Industries

Vapor Extraction

July 21, 2020 9:30 am

07/22/2020

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
107-05-1	3-Chloropropene	ND		ug/m ³	2.2	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
108-10-1	4-Methyl-2-pentanone	1.1		ug/m ³	0.57	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
67-64-1	Acetone	29		ug/m ³	0.66	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
107-13-1	Acrylonitrile	ND		ug/m ³	0.30	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
71-43-2	Benzene	0.62		ug/m ³	0.45	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
100-44-7	Benzyl chloride	ND		ug/m ³	0.72	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-27-4	Bromodichloromethane	ND		ug/m ³	0.94	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-25-2	Bromoform	ND		ug/m ³	1.4	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
74-83-9	Bromomethane	ND		ug/m ³	0.54	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-15-0	Carbon disulfide	0.52		ug/m ³	0.43	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
56-23-5	Carbon tetrachloride	0.53		ug/m ³	0.22	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
108-90-7	Chlorobenzene	ND		ug/m ³	0.64	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-00-3	Chloroethane	ND		ug/m ³	0.37	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
67-66-3	Chloroform	ND		ug/m ³	0.68	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
74-87-3	Chloromethane	2.2		ug/m ³	0.29	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
156-59-2	cis-1,2-Dichloroethylene	0.77		ug/m ³	0.14	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.63	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
110-82-7	Cyclohexane	ND		ug/m ³	0.48	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
124-48-1	Dibromochloromethane	ND		ug/m ³	1.2	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-71-8	Dichlorodifluoromethane	2.1		ug/m ³	0.69	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
141-78-6	* Ethyl acetate	6.0		ug/m ³	1.0	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ
100-41-4	Ethyl Benzene	1.1		ug/m ³	0.61	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.5	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ



Sample Information

Client Sample ID: A Q072120:930NP4-1

York Sample ID: 20G0775-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0775

31402600.000 Task 01.00 Rowe Industries

Vapor Extraction

July 21, 2020 9:30 am

07/22/2020

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
67-63-0	Isopropanol	88		ug/m ³	0.69	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.57	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.50	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-09-2	Methylene chloride	2.6		ug/m ³	0.97	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
142-82-5	n-Heptane	ND		ug/m ³	0.57	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
110-54-3	n-Hexane	3.4		ug/m ³	0.49	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
95-47-6	o-Xylene	1.1		ug/m ³	0.61	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
179601-23-1	p- & m- Xylenes	3.5		ug/m ³	1.2	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
622-96-8	* p-Ethyltoluene	1.2		ug/m ³	0.69	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ
115-07-1	* Propylene	ND		ug/m ³	0.24	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ
100-42-5	Styrene	2.6		ug/m ³	0.59	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
127-18-4	Tetrachloroethylene	19		ug/m ³	0.95	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
109-99-9	* Tetrahydrofuran	1.6		ug/m ³	0.82	1.396	EPA TO-15 Certifications:	07/23/2020 09:00	07/24/2020 14:55	LLJ
108-88-3	Toluene	9.9		ug/m ³	0.53	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.55	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.63	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
79-01-6	Trichloroethylene	0.90		ug/m ³	0.19	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-69-4	Trichlorofluoromethane (Freon 11)	1.6		ug/m ³	0.78	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
108-05-4	Vinyl acetate	ND		ug/m ³	0.49	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
593-60-2	Vinyl bromide	ND		ug/m ³	0.61	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
75-01-4	Vinyl Chloride	ND		ug/m ³	0.18	1.396	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/23/2020 09:00	07/24/2020 14:55	LLJ
	Surrogate Recoveries	Result		Acceptance Range						
460-00-4	Surrogate: SURR: p-Bromofluorobenzene	100 %		70-130						



Sample Information

Client Sample ID: AQ072120:930NP4-1

York Sample ID: 20G0775-01

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
20G0775	31402600.000 Task 01.00 Rowe Industries	Vapor Extraction	July 21, 2020 9:30 am	07/22/2020

Sample Information

Client Sample ID: AQ072120:935NP4-3

York Sample ID: 20G0775-02

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
20G0775	31402600.000 Task 01.00 Rowe Industries	Vapor Extraction	July 21, 2020 9:35 am	07/22/2020

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	* 1,1,1,2-Tetrachloroethane	ND		ug/m ³	1.0	1.504	EPA TO-15 Certifications:	07/26/2020 09:00	07/27/2020 19:11	AS
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	0.82	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	1.0	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	1.2	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	0.82	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-34-3	1,1-Dichloroethane	ND		ug/m ³	0.61	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	0.15	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	1.1	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
95-63-6	1,2,4-Trimethylbenzene	1.3		ug/m ³	0.74	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
106-93-4	1,2-Dibromoethane	ND		ug/m ³	1.2	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	0.90	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
107-06-2	1,2-Dichloroethane	ND		ug/m ³	0.61	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
78-87-5	1,2-Dichloropropane	ND		ug/m ³	0.69	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	1.1	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	0.74	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
106-99-0	1,3-Butadiene	ND		ug/m ³	1.0	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	0.90	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
142-28-9	* 1,3-Dichloropropane	ND		ug/m ³	0.70	1.504	EPA TO-15 Certifications:	07/26/2020 09:00	07/27/2020 19:11	AS
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	0.90	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS



Sample Information

Client Sample ID: AQ072120:935NP4-3

York Sample ID: 20G0775-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0775

31402600.000 Task 01.00 Rowe Industries

Vapor Extraction

July 21, 2020 9:35 am

07/22/2020

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
123-91-1	1,4-Dioxane	ND		ug/m ³	1.1	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
78-93-3	2-Butanone	3.9		ug/m ³	0.44	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
591-78-6	* 2-Hexanone	ND		ug/m ³	1.2	1.504	EPA TO-15 Certifications:	07/26/2020 09:00	07/27/2020 19:11	AS
107-05-1	3-Chloropropene	ND		ug/m ³	2.4	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
108-10-1	4-Methyl-2-pentanone	3.5		ug/m ³	0.62	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
67-64-1	Acetone	49		ug/m ³	0.71	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
107-13-1	Acrylonitrile	ND		ug/m ³	0.33	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
71-43-2	Benzene	0.77		ug/m ³	0.48	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
100-44-7	Benzyl chloride	ND		ug/m ³	0.78	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-27-4	Bromodichloromethane	ND		ug/m ³	1.0	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-25-2	Bromoform	ND		ug/m ³	1.6	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
74-83-9	Bromomethane	1.2		ug/m ³	0.58	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-15-0	Carbon disulfide	0.70		ug/m ³	0.47	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
56-23-5	Carbon tetrachloride	0.28		ug/m ³	0.24	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
108-90-7	Chlorobenzene	ND		ug/m ³	0.69	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-00-3	Chloroethane	ND		ug/m ³	0.40	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
67-66-3	Chloroform	ND		ug/m ³	0.73	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
74-87-3	Chloromethane	2.4		ug/m ³	0.31	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
156-59-2	cis-1,2-Dichloroethylene	0.89		ug/m ³	0.15	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	0.68	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
110-82-7	Cyclohexane	ND		ug/m ³	0.52	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
124-48-1	Dibromochloromethane	ND		ug/m ³	1.3	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-71-8	Dichlorodifluoromethane	2.2		ug/m ³	0.74	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS



Sample Information

Client Sample ID: A Q072120:935NP4-3

York Sample ID: 20G0775-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0775

31402600.000 Task 01.00 Rowe Industries

Vapor Extraction

July 21, 2020 9:35 am

07/22/2020


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
141-78-6	* Ethyl acetate	4.5		ug/m ³	1.1	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
100-41-4	Ethyl Benzene	2.3		ug/m ³	0.65	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
87-68-3	Hexachlorobutadiene	ND		ug/m ³	1.6	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
67-63-0	Isopropanol	370	TO-IPA, E	ug/m ³	0.74	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
80-62-6	Methyl Methacrylate	ND		ug/m ³	0.62	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	0.54	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
75-09-2	Methylene chloride	1.1		ug/m ³	1.0	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
142-82-5	n-Heptane	4.1		ug/m ³	0.62	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
110-54-3	n-Hexane	2.5		ug/m ³	0.53	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
95-47-6	o-Xylene	2.0		ug/m ³	0.65	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
179601-23-1	p- & m- Xylenes	7.4		ug/m ³	1.3	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
622-96-8	* p-Ethyltoluene	1.3		ug/m ³	0.74	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
115-07-1	* Propylene	ND		ug/m ³	0.26	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
100-42-5	Styrene	4.0		ug/m ³	0.64	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
127-18-4	Tetrachloroethylene	5.1		ug/m ³	1.0	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
109-99-9	* Tetrahydrofuran	1.2		ug/m ³	0.89	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
108-88-3	Toluene	22		ug/m ³	0.57	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	0.60	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	0.68	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
79-01-6	Trichloroethylene	ND		ug/m ³	0.20	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
75-69-4	Trichlorofluoromethane (Freon 11)	1.4		ug/m ³	0.85	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS
108-05-4	Vinyl acetate	ND		ug/m ³	0.53	1.504	EPA TO-15	07/26/2020 09:00	07/27/2020 19:11	AS



Sample Information

Client Sample ID: AQ072120:935NP4-3

York Sample ID: 20G0775-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

20G0775

31402600.000 Task 01.00 Rowe Industries

Vapor Extraction

July 21, 2020 9:35 am

07/22/2020


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes: TO-VAC

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
593-60-2	Vinyl bromide	ND		ug/m ³	0.66	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
75-01-4	Vinyl Chloride	ND		ug/m ³	0.19	1.504	EPA TO-15 Certifications: NELAC-NY12058,NJDEP-Queens	07/26/2020 09:00	07/27/2020 19:11	AS
	Surrogate Recoveries	Result					Acceptance Range			
460-00-4	Surrogate: <i>SURR:</i> <i>p-Bromofluorobenzene</i>	93.5 %					70-130			



Analytical Batch Summary

Batch ID: BG01146 **Preparation Method:** EPA TO15 PREP **Prepared By:** AS

YORK Sample ID	Client Sample ID	Preparation Date
20G0775-01	AQ072120:930NP4-1	07/23/20
BG01146-BLK1	Blank	07/23/20
BG01146-BS1	LCS	07/23/20

Batch ID: BG01281 **Preparation Method:** EPA TO15 PREP **Prepared By:** AS

YORK Sample ID	Client Sample ID	Preparation Date
20G0775-02	AQ072120:935NP4-3	07/26/20
BG01281-BLK1	Blank	07/26/20
BG01281-BS1	LCS	07/26/20



Volatile Organic Compounds in Air by GC/MS - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG01146 - EPA TO15 PREP

Blank (BG01146-BLK1)

Prepared: 07/23/2020 Analyzed: 07/24/2020

1,1,1,2-Tetrachloroethane	ND	0.69	ug/m ³								
1,1,1-Trichloroethane	ND	0.55	"								
1,1,2,2-Tetrachloroethane	ND	0.69	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.77	"								
1,1,2-Trichloroethane	ND	0.55	"								
1,1-Dichloroethane	ND	0.40	"								
1,1-Dichloroethylene	ND	0.099	"								
1,2,4-Trichlorobenzene	ND	0.74	"								
1,2,4-Trimethylbenzene	ND	0.49	"								
1,2-Dibromoethane	ND	0.77	"								
1,2-Dichlorobenzene	ND	0.60	"								
1,2-Dichloroethane	ND	0.40	"								
1,2-Dichloropropane	ND	0.46	"								
1,2-Dichlorotetrafluoroethane	ND	0.70	"								
1,3,5-Trimethylbenzene	ND	0.49	"								
1,3-Butadiene	ND	0.66	"								
1,3-Dichlorobenzene	ND	0.60	"								
1,3-Dichloropropane	ND	0.46	"								
1,4-Dichlorobenzene	ND	0.60	"								
1,4-Dioxane	ND	0.72	"								
2-Butanone	ND	0.29	"								
2-Hexanone	ND	0.82	"								
3-Chloropropene	ND	1.6	"								
4-Methyl-2-pentanone	ND	0.41	"								
Acetone	ND	0.48	"								
Acrylonitrile	ND	0.22	"								
Benzene	ND	0.32	"								
Benzyl chloride	ND	0.52	"								
Bromodichloromethane	ND	0.67	"								
Bromoform	ND	1.0	"								
Bromomethane	ND	0.39	"								
Carbon disulfide	ND	0.31	"								
Carbon tetrachloride	ND	0.16	"								
Chlorobenzene	ND	0.46	"								
Chloroethane	ND	0.26	"								
Chloroform	ND	0.49	"								
Chloromethane	ND	0.21	"								
cis-1,2-Dichloroethylene	ND	0.099	"								
cis-1,3-Dichloropropylene	ND	0.45	"								
Cyclohexane	ND	0.34	"								
Dibromochloromethane	ND	0.85	"								
Dichlorodifluoromethane	ND	0.49	"								
Ethyl acetate	ND	0.72	"								
Ethyl Benzene	ND	0.43	"								
Hexachlorobutadiene	ND	1.1	"								
Isopropanol	ND	0.49	"								
Methyl Methacrylate	ND	0.41	"								
Methyl tert-butyl ether (MTBE)	ND	0.36	"								
Methylene chloride	ND	0.69	"								



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BG01146 - EPA TO15 PREP

Blank (BG01146-BLK1)

Prepared: 07/23/2020 Analyzed: 07/24/2020

n-Heptane	ND	0.41	ug/m ³								
n-Hexane	ND	0.35	"								
o-Xylene	ND	0.43	"								
p- & m- Xylenes	ND	0.87	"								
p-Ethyltoluene	ND	0.49	"								
Propylene	ND	0.17	"								
Styrene	ND	0.43	"								
Tetrachloroethylene	ND	0.68	"								
Tetrahydrofuran	ND	0.59	"								
Toluene	ND	0.38	"								
trans-1,2-Dichloroethylene	ND	0.40	"								
trans-1,3-Dichloropropylene	ND	0.45	"								
Trichloroethylene	ND	0.13	"								
Trichlorofluoromethane (Freon 11)	ND	0.56	"								
Vinyl acetate	ND	0.35	"								
Vinyl bromide	ND	0.44	"								
Vinyl Chloride	ND	0.13	"								
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	7.98		ppbv	10.0		79.8	70-130				

LCS (BG01146-BS1)

Prepared: 07/23/2020 Analyzed: 07/24/2020

1,1,1,2-Tetrachloroethane	10.1		ppbv	10.0		101	70-130				
1,1,1-Trichloroethane	9.93		"	10.0		99.3	70-130				
1,1,2,2-Tetrachloroethane	9.53		"	10.0		95.3	70-130				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.5		"	10.0		105	70-130				
1,1,2-Trichloroethane	9.09		"	10.0		90.9	70-130				
1,1-Dichloroethane	9.85		"	10.0		98.5	70-130				
1,1-Dichloroethylene	9.53		"	10.0		95.3	70-130				
1,2,4-Trichlorobenzene	11.4		"	10.0		114	70-130				
1,2,4-Trimethylbenzene	9.21		"	10.0		92.1	70-130				
1,2-Dibromoethane	9.16		"	10.0		91.6	70-130				
1,2-Dichlorobenzene	11.0		"	10.0		110	70-130				
1,2-Dichloroethane	8.91		"	10.0		89.1	70-130				
1,2-Dichloropropane	8.27		"	10.0		82.7	70-130				
1,2-Dichlorotetrafluoroethane	10.5		"	10.0		105	70-130				
1,3,5-Trimethylbenzene	8.98		"	10.0		89.8	70-130				
1,3-Butadiene	10.9		"	10.0		109	70-130				
1,3-Dichlorobenzene	11.4		"	10.0		114	70-130				
1,3-Dichloropropane	8.33		"	10.0		83.3	70-130				
1,4-Dichlorobenzene	11.3		"	10.0		113	70-130				
1,4-Dioxane	7.04		"	10.0		70.4	70-130				
2-Butanone	9.35		"	10.0		93.5	70-130				
2-Hexanone	8.07		"	10.0		80.7	70-130				
3-Chloropropene	10.1		"	10.0		101	70-130				
4-Methyl-2-pentanone	7.25		"	10.0		72.5	70-130				
Acetone	9.35		"	10.0		93.5	70-130				
Acrylonitrile	9.74		"	10.0		97.4	70-130				
Benzene	9.89		"	10.0		98.9	70-130				
Benzyl chloride	10.8		"	10.0		108	70-130				
Bromodichloromethane	8.34		"	10.0		83.4	70-130				
Bromoform	11.4		"	10.0		114	70-130				



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting		Spike	Source*		%REC	Limits	Flag	RPD	
		Limit	Units		Level	Result				%REC	RPD

Batch BG01146 - EPA TO15 PREP

LCS (BG01146-BS1)

Prepared: 07/23/2020 Analyzed: 07/24/2020

Bromomethane	10.8		ppbv	10.0		108	70-130				
Carbon disulfide	10.4		"	10.0		104	70-130				
Carbon tetrachloride	10.0		"	10.0		100	70-130				
Chlorobenzene	9.93		"	10.0		99.3	70-130				
Chloroethane	11.4		"	10.0		114	70-130				
Chloroform	9.92		"	10.0		99.2	70-130				
Chloromethane	11.1		"	10.0		111	70-130				
cis-1,2-Dichloroethylene	9.62		"	10.0		96.2	70-130				
cis-1,3-Dichloropropylene	8.40		"	10.0		84.0	70-130				
Cyclohexane	10.3		"	10.0		103	70-130				
Dibromochloromethane	9.57		"	10.0		95.7	70-130				
Dichlorodifluoromethane	9.61		"	10.0		96.1	70-130				
Ethyl acetate	9.68		"	10.0		96.8	70-130				
Ethyl Benzene	8.72		"	10.0		87.2	70-130				
Hexachlorobutadiene	9.97		"	10.0		99.7	70-130				
Isopropanol	9.92		"	10.0		99.2	70-130				
Methyl Methacrylate	8.52		"	10.0		85.2	70-130				
Methyl tert-butyl ether (MTBE)	9.73		"	10.0		97.3	70-130				
Methylene chloride	10.4		"	10.0		104	70-130				
n-Heptane	9.99		"	10.0		99.9	70-130				
n-Hexane	10.2		"	10.0		102	70-130				
o-Xylene	8.57		"	10.0		85.7	70-130				
p- & m- Xylenes	17.7		"	20.0		88.7	70-130				
p-Ethyltoluene	10.2		"	10.0		102	70-130				
Propylene	11.3		"	10.0		113	70-130				
Styrene	9.85		"	10.0		98.5	70-130				
Tetrachloroethylene	9.28		"	10.0		92.8	70-130				
Tetrahydrofuran	9.65		"	10.0		96.5	70-130				
Toluene	8.41		"	10.0		84.1	70-130				
trans-1,2-Dichloroethylene	9.87		"	10.0		98.7	70-130				
trans-1,3-Dichloropropylene	8.32		"	10.0		83.2	70-130				
Trichloroethylene	8.37		"	10.0		83.7	70-130				
Trichlorofluoromethane (Freon 11)	9.82		"	10.0		98.2	70-130				
Vinyl acetate	9.88		"	10.0		98.8	70-130				
Vinyl bromide	11.3		"	10.0		113	70-130				
Vinyl Chloride	10.1		"	10.0		101	70-130				
Surrogate: SURR: p-Bromofluorobenzene	9.23		"	10.0		92.3	70-130				



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit								RPD	

Batch BG01281 - EPA TO15 PREP

Blank (BG01281-BLK1)

Prepared: 07/26/2020 Analyzed: 07/27/2020

1,1,1,2-Tetrachloroethane	ND	0.69	ug/m ³
1,1,1-Trichloroethane	ND	0.55	"
1,1,2,2-Tetrachloroethane	ND	0.69	"
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.77	"
1,1,2-Trichloroethane	ND	0.55	"
1,1-Dichloroethane	ND	0.40	"
1,1-Dichloroethylene	ND	0.099	"
1,2,4-Trichlorobenzene	ND	0.74	"
1,2,4-Trimethylbenzene	ND	0.49	"
1,2-Dibromoethane	ND	0.77	"
1,2-Dichlorobenzene	ND	0.60	"
1,2-Dichloroethane	ND	0.40	"
1,2-Dichloropropane	ND	0.46	"
1,2-Dichlorotetrafluoroethane	ND	0.70	"
1,3,5-Trimethylbenzene	ND	0.49	"
1,3-Butadiene	ND	0.66	"
1,3-Dichlorobenzene	ND	0.60	"
1,3-Dichloropropane	ND	0.46	"
1,4-Dichlorobenzene	ND	0.60	"
1,4-Dioxane	ND	0.72	"
2-Butanone	ND	0.29	"
2-Hexanone	ND	0.82	"
3-Chloropropene	ND	1.6	"
4-Methyl-2-pentanone	ND	0.41	"
Acetone	ND	0.48	"
Acrylonitrile	ND	0.22	"
Benzene	ND	0.32	"
Benzyl chloride	ND	0.52	"
Bromodichloromethane	ND	0.67	"
Bromoform	ND	1.0	"
Bromomethane	ND	0.39	"
Carbon disulfide	ND	0.31	"
Carbon tetrachloride	ND	0.16	"
Chlorobenzene	ND	0.46	"
Chloroethane	ND	0.26	"
Chloroform	ND	0.49	"
Chloromethane	ND	0.21	"
cis-1,2-Dichloroethylene	ND	0.099	"
cis-1,3-Dichloropropylene	ND	0.45	"
Cyclohexane	ND	0.34	"
Dibromochloromethane	ND	0.85	"
Dichlorodifluoromethane	ND	0.49	"
Ethyl acetate	ND	0.72	"
Ethyl Benzene	ND	0.43	"
Hexachlorobutadiene	ND	1.1	"
Isopropanol	ND	0.49	"
Methyl Methacrylate	ND	0.41	"
Methyl tert-butyl ether (MTBE)	ND	0.36	"
Methylene chloride	ND	0.69	"
n-Heptane	ND	0.41	"



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BG01281 - EPA TO15 PREP

Blank (BG01281-BLK1)

Prepared: 07/26/2020 Analyzed: 07/27/2020

n-Hexane	ND	0.35	ug/m ³								
o-Xylene	ND	0.43	"								
p- & m- Xylenes	ND	0.87	"								
p-Ethyltoluene	ND	0.49	"								
Propylene	ND	0.17	"								
Styrene	ND	0.43	"								
Tetrachloroethylene	ND	0.68	"								
Tetrahydrofuran	ND	0.59	"								
Toluene	ND	0.38	"								
trans-1,2-Dichloroethylene	ND	0.40	"								
trans-1,3-Dichloropropylene	ND	0.45	"								
Trichloroethylene	ND	0.13	"								
Trichlorofluoromethane (Freon 11)	ND	0.56	"								
Vinyl acetate	ND	0.35	"								
Vinyl bromide	ND	0.44	"								
Vinyl Chloride	ND	0.13	"								

Surrogate: SURR: p-Bromofluorobenzene 7.95 ppbv 10.0 79.5 70-130

LCS (BG01281-BS1)

Prepared: 07/26/2020 Analyzed: 07/27/2020

1,1,1,2-Tetrachloroethane	9.57		ppbv	10.0		95.7	70-130				
1,1,1-Trichloroethane	10.1		"	10.0		101	70-130				
1,1,2,2-Tetrachloroethane	9.18		"	10.0		91.8	70-130				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.6		"	10.0		106	70-130				
1,1,2-Trichloroethane	8.96		"	10.0		89.6	70-130				
1,1-Dichloroethane	10.0		"	10.0		100	70-130				
1,1-Dichloroethylene	9.62		"	10.0		96.2	70-130				
1,2,4-Trichlorobenzene	10.5		"	10.0		105	70-130				
1,2,4-Trimethylbenzene	8.68		"	10.0		86.8	70-130				
1,2-Dibromoethane	9.01		"	10.0		90.1	70-130				
1,2-Dichlorobenzene	10.4		"	10.0		104	70-130				
1,2-Dichloroethane	9.14		"	10.0		91.4	70-130				
1,2-Dichloropropane	8.19		"	10.0		81.9	70-130				
1,2-Dichlorotetrafluoroethane	10.4		"	10.0		104	70-130				
1,3,5-Trimethylbenzene	8.99		"	10.0		89.9	70-130				
1,3-Butadiene	10.2		"	10.0		102	70-130				
1,3-Dichlorobenzene	10.6		"	10.0		106	70-130				
1,3-Dichloropropane	8.24		"	10.0		82.4	70-130				
1,4-Dichlorobenzene	10.7		"	10.0		107	70-130				
1,4-Dioxane	6.99		"	10.0		69.9	70-130			Low Bias	
2-Butanone	9.41		"	10.0		94.1	70-130				
2-Hexanone	7.91		"	10.0		79.1	70-130				
3-Chloropropene	10.1		"	10.0		101	70-130				
4-Methyl-2-pentanone	7.22		"	10.0		72.2	70-130				
Acetone	9.59		"	10.0		95.9	70-130				
Acrylonitrile	10.0		"	10.0		100	70-130				
Benzene	9.92		"	10.0		99.2	70-130				
Benzyl chloride	10.2		"	10.0		102	70-130				
Bromodichloromethane	8.28		"	10.0		82.8	70-130				
Bromoform	10.6		"	10.0		106	70-130				
Bromomethane	11.0		"	10.0		110	70-130				



Volatile Organic Compounds in Air by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	

Batch BG01281 - EPA TO15 PREP

LCS (BG01281-BS1)

Prepared: 07/26/2020 Analyzed: 07/27/2020

Carbon disulfide	10.6		ppbv	10.0		106	70-130				
Carbon tetrachloride	9.99		"	10.0		99.9	70-130				
Chlorobenzene	9.40		"	10.0		94.0	70-130				
Chloroethane	11.6		"	10.0		116	70-130				
Chloroform	10.0		"	10.0		100	70-130				
Chloromethane	10.4		"	10.0		104	70-130				
cis-1,2-Dichloroethylene	9.84		"	10.0		98.4	70-130				
cis-1,3-Dichloropropylene	8.33		"	10.0		83.3	70-130				
Cyclohexane	10.3		"	10.0		103	70-130				
Dibromochloromethane	9.29		"	10.0		92.9	70-130				
Dichlorodifluoromethane	9.78		"	10.0		97.8	70-130				
Ethyl acetate	9.84		"	10.0		98.4	70-130				
Ethyl Benzene	8.39		"	10.0		83.9	70-130				
Hexachlorobutadiene	9.91		"	10.0		99.1	70-130				
Isopropanol	10.1		"	10.0		101	70-130				
Methyl Methacrylate	8.49		"	10.0		84.9	70-130				
Methyl tert-butyl ether (MTBE)	9.82		"	10.0		98.2	70-130				
Methylene chloride	10.6		"	10.0		106	70-130				
n-Heptane	9.87		"	10.0		98.7	70-130				
n-Hexane	10.2		"	10.0		102	70-130				
o-Xylene	8.14		"	10.0		81.4	70-130				
p- & m- Xylenes	16.8		"	20.0		84.2	70-130				
p-Ethyltoluene	9.93		"	10.0		99.3	70-130				
Propylene	11.4		"	10.0		114	70-130				
Styrene	9.38		"	10.0		93.8	70-130				
Tetrachloroethylene	9.03		"	10.0		90.3	70-130				
Tetrahydrofuran	9.63		"	10.0		96.3	70-130				
Toluene	8.23		"	10.0		82.3	70-130				
trans-1,2-Dichloroethylene	9.94		"	10.0		99.4	70-130				
trans-1,3-Dichloropropylene	8.29		"	10.0		82.9	70-130				
Trichloroethylene	8.36		"	10.0		83.6	70-130				
Trichlorofluoromethane (Freon 11)	9.93		"	10.0		99.3	70-130				
Vinyl acetate	9.94		"	10.0		99.4	70-130				
Vinyl bromide	11.4		"	10.0		114	70-130				
Vinyl Chloride	9.44		"	10.0		94.4	70-130				
Surrogate: SURR: p-Bromofluorobenzene	8.97		"	10.0		89.7	70-130				





Sample and Data Qualifiers Relating to This Work Order

TO-VAC	The final vacuum in the canister was less than -2 inches Hg vacuum. The time integrated sampling may be affected and not reflect proper sampling over the time period. The data user should take note.
TO-LCS-L	The result reported for this compound may be biased low due to its behavior in the analysis batch LCS where it recovered less 70% of the expected value.
TO-IPA	The value for isopropanol is estimated. Dilutions are not conducted for this species as not to preclude actionable analytes by dilution.
E	The concentration indicated for this analyte is an estimated value above the calibration range of the instrument. This value is considered an estimate.

Definitions and Other Explanations


*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.



Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.

For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.
 120 Research Drive Stratford, CT 06615
 132-02 89th Ave Queens, NY 11418



clientservices@yorklab.com
 www.yorklab.com

Field Chain-of-Custody Record - AIR

YORK Project No.
 2060775

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document. This document serves as your written authorization for YORK to proceed with the analyses requested below. Your signature binds you to YORK's Standard Terms & Conditions.

Your Page 1 of 1

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company: WSP USA		Company: Same		Company: WSP USA Accounting		31402660.000 31401451.000 Task 01.00		RUSH - Next Day	
Address: 4 Research Drive, Suite 204 Shelton, CT 06484		Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone.: 203-929-8555		Phone.:		Phone.:				RUSH - Three Day	
Contact: Tunde Komuves-Sandor		Contact:		Contact:		YOUR PO#: 31401451.000 Task 01.00		RUSH - Four Day	
E-mail: tunde.sandor@wsp.com		E-mail:		E-mail:				Standard (5-7 Day)	

Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.

Samples Collected by: (print your name above and sign below) <i>Scott Philbrick</i> <i>[Signature]</i>	Air Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp. Compared to the following Regulation(s): (please fill in)	
	AI - Indoor Ambient Air	New York	<input checked="" type="checkbox"/>	Summary Report	CT RCP		Standard Excel EDD
	AO - Outdoor Amb. Air	New Jersey		QA Report	CT RCP DQA/DUE		EquiS (Standard)
	AE - Vapor Extraction Well/ Process Gas/Effluent	Connecticut		NY ASP A Package	NJDEP Reduced Deliv.		NYSDEC EquiS
	AS - Soil Vapor/Sub-Slab	Pennsylvania		NY ASP B Package	NJDKQP		NJDEP SRP HazSite
		Other:					

Certified Canisters: Batch ___ Individual ___		Please enter the following REQUIRED Field Data					Reporting Units: ug/m ³ ___ ppbv ___ ppmv ___	
Sample Identification	Date/Time Sampled	Air Matrix	Canister Vacuum Before Sampling (in Hg)	Canister Vacuum After Sampling (in Hg)	Canister ID	Flow Cont. ID	Analysis Requested	
NP4-1 AQ072120:930NP4	7-21-20 9:30	AE	-30	-6	15413		TO-15	
NP4-3 AQ072120:935NP4	7-21-20 9:35	AE	-30	-4	24121		TO-15	

Comments:	Detection Limits Required	Sampling Media
	≤ 1 ug/m ³ ___ NYSDEC V1 Limits ___ Routine Survey ___ Other ___	6 Liter Canister Tedlar Bag

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
<i>[Signature]</i> WSP	7-21-20 12:12	TC <i>[Signature]</i> / YORK	7/21/20 1512	<i>[Signature]</i> / YORK	7-21-20/1850
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
<i>[Signature]</i> York	7-21-20 1850	<i>[Signature]</i> York	7-22-20 830am	Queens Sewer Room	7/22/20 8:30AM
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Date/Time
		Lab Secure	7/22/20	<i>[Signature]</i>	0930